

UP TO 16.5 SEER2
1½ TO 5 TONS

R-32 SPLIT SYSTEM AIR CONDITIONER



Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data	4
Performance Data	18
AHRI Ratings (see note).....	19
Dimensions	20
Wiring Diagrams	22
Accessories	23

R32

Standard Features

- High efficiency scroll compressor
- High-density foam compressor sound blanket
- Advanced Copeland® CoreSense™ Technology
- Fully charged for 15' of tubing length
- Copper tube/ enhanced aluminum fin coil 5mm diameter
- Factory-installed filter drier
- Sweat connection service valves with easy access to gauge ports
- Enclosed contactor
- High-pressure switch
- Ground lug connection
- Capacitors with extended life
- AHRI Certified
- ETL Listed

Cabinet Features

- Removable grille-style top design compliant with UL 60335-2-40
- Venturi for increased velocity of airflow
- Custom Nickel Gray powder-paint finish
- 500-hour salt-spray tested
- Wire fan discharge grille
- Steel louver coil guard
- Rust-resistant coated screws
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets the 2023 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.

* Complete warranty available from your local dealer or at www.daikincomfort.com. To receive the 6-Year Unit Replacement Limited Warranty and 12-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California, Florida, or Quebec. The duration of warranty coverages in Texas and Florida differs in some cases. Other limitations and exclusions apply, refer to complete warranty details for full list of limitations and exclusions. Additional requirements for annual maintenance are required for the 6-Year Unit Replacement Limited Warranty. Changes in law, regulations, or technology may result in an equivalent unit not being available. Other limitations and exclusions apply, refer to complete warranty details for full list of limitations and exclusions, as well as rights and obligations should an equivalent unit not be available.

	D	C	5	S	E	A	36	1	0	A	A	
	1	2	3	4	5	6	7,8	9	10	11	12	
Brand												Minor Rev
D - Daikin												A: Initial Release
												B: 1st Revision
Type - Split System												Major Rev
C - Condenser R-32												A: Initial Release
H - Heat Pump R-32												B: 1st Revision
												Variation
Efficiency (SEER2) Nominal												
13.4 - 13.7 = 3												
13.8 - 14.5 = 4												
14.6 - 15.9 = 5												
19.0+ = 9												
											</	

	DC5SEA 1810A*	DC5SEA 2410A*	DC5SEA 3010A*	DC5SEA 3610A*	DC5SEA 4210A*	DC5SEA 4810A*	DC5SEA 6010A*
COOLING CAPACITY							
Nominal Cooling (BTU/h)	18,000	24,000	30,000	36,000	42,000	48,000	60,000
Decibels (dBA)	71.0	67.0	71.0	69.0	72.0	73.0	74.0
COMPRESSOR							
RLA	8.3	10.2	11.5	13.4	14.4	19.4	27.1
LRA	44.3	59.3	66.3	83.3	112.2	127.7	178
Stage	Single	Single	Single	Single	Single	Single	Two
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
CONDENSER FAN MOTOR							
Motor Type	PSC	PSC	PSC	PSC	PSC	PSC	ECM
Horsepower	1/8	1/6	1/6	1/6	1/4	1/4	1/3
FLA	0.70	0.95	0.95	0.95	1.30	1.30	2.60
REFRIGERATION SYSTEM							
Refrigerant Line Size ¹							
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	3/4"	7/8"	1 1/8"	1 1/8"	1 1/8"
Refrigerant Connection Size							
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) ^{2, 3}	3/4"	3/4"	3/4"	7/8"	7/8"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge ³	54	65	87	88	141	138	167
ELECTRICAL DATA							
Voltage-Phase	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity ⁴	11.1	13.8	15.4	17.8	19.3	25.5	36.4
Max. Overcurrent Protection ⁵	15	20	25	30	30	40	60
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
UNIT WEIGHTS							
Equipment Weight	116	149	192	191	250	249	287
Shipping Weight	134	167	214	213	272	271	309
ENERGY STAR® CERTIFIED							
							

¹ Line sizes denoted for 25' line sets, tested and rated in accordance with ARI Standard 210/240. For other line set lengths or sizes, refer to the Installation Instructions and/or the Long Line Set Applications guide.

² Installer will need to supply 3/8" to 7/8" adapters for suction line connections.

³ Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.

⁴ Unit is factory charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per the Final Charge Adjustment procedure found in the Installation Instructions.

⁵ Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes.

⁶ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.

ENERGY STAR NOTES

Proper sizing and installation of equipment is critical to achieving optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR criteria. Ask your contractor for details or visit www.energystar.gov. The www.energystar.gov website provides up-to-date system combinations certified to meet ENERGY STAR requirements.

		OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
		ENTERING INDOOR WET BULB TEMPERATURE																																			
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
70		MBh	18.1	18.4	18.9	-	18.0	18.2	18.8	-	17.5	17.8	18.3	-	16.7	17.0	17.5	-	15.7	16.0	16.5	-	14.8	15.1	15.6	-											
	525	S/T	0.62	0.55	0.42	-	0.63	0.56	0.43	-	0.65	0.58	0.45	-	0.67	0.60	0.47	-	0.69	0.62	0.49	-	1.00	0.67	0.54	-											
		ΔT	21	19	15	-	21	19	15	-	21	19	15	-	21	19	15	-	20	18	14	-	22	20	16	-											
		kW	1.12	1.11	1.11	-	1.24	1.24	1.23	-	1.37	1.37	1.37	-	1.52	1.52	1.52	-	1.68	1.68	1.68	-	1.87	1.87	1.87	-											
		Amps	4.0	4.0	4.0	-	4.6	4.6	4.6	-	5.2	5.2	5.2	-	5.9	5.9	5.9	-	6.6	6.6	6.6	-	7.5	7.5	7.5	-											
70		MBh	18.5	18.7	19.3	-	18.3	18.6	19.1	-	17.8	18.1	18.6	-	17.0	17.3	17.8	-	16.1	16.3	16.8	-	15.2	15.4	15.9	-											
	600	S/T	0.66	0.58	0.46	-	0.66	0.59	0.46	-	0.69	0.61	0.49	-	0.70	0.63	0.51	-	0.72	0.65	0.53	-	1.00	0.70	0.57	-											
		ΔT	19	17	14	-	19	17	14	-	20	18	14	-	19	17	14	-	19	17	13	-	20	18	15	-											
		kW	1.12	1.12	1.12	-	1.24	1.24	1.24	-	1.38	1.38	1.37	-	1.52	1.52	1.52	-	1.69	1.69	1.69	-	1.88	1.88	1.88	-											
		Amps	4.1	4.1	4.1	-	4.6	4.6	4.6	-	5.2	5.2	5.2	-	5.9	5.9	5.9	-	6.7	6.7	6.7	-	7.5	7.5	7.5	-											
70		MBh	18.9	19.1	19.7	-	18.7	19.0	19.5	-	18.2	18.5	19.0	-	17.4	17.7	18.2	-	16.5	16.7	17.2	-	15.6	15.8	16.3	-											
	675	S/T	0.66	0.59	0.47	-	0.67	0.60	0.47	-	0.69	0.62	0.49	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-											
		ΔT	18	16	13	-	18	16	13	-	19	17	13	-	18	16	13	-	18	16	12	-	19	17	14	-											
		kW	1.13	1.13	1.12	-	1.25	1.25	1.24	-	1.38	1.38	1.38	-	1.53	1.53	1.53	-	1.69	1.69	1.69	-	1.89	1.88	1.88	-											
		Amps	4.1	4.1	4.1	-	4.6	4.6	4.6	-	5.3	5.3	5.3	-	5.9	5.9	5.9	-	6.7	6.7	6.7	-	7.6	7.6	7.6	-											

75	MBh	18.2	18.4	18.9	19.8	18.0	18.2	18.8	19.6	17.5	17.8	18.3	19.1	16.7	17.0	17.5	18.3	15.7	16.0	16.5	17.3	14.8	15.1	15.6	16.4	13.5	13.8	14.3	15.1	15.6	16.3	17.1
	S/T	0.74	0.67	0.54	0.4	0.75	0.68	0.55	0.4	0.77	0.70	0.57	0.4	1.00	0.72	0.59	0.5	1.00	0.74	0.61	0.5	1.00	0.79	0.66	0.5	1.00	0.79	0.66	0.5	1.00	0.79	0.66
	ΔT	25	23	19	15	25	23	19	15	25	23	20	16	25	23	19	15	25	23	19	15	26	24	20	16	26	24	20	16	26	24	20
	kW	1.11	1.11	1.11	1.1	1.24	1.23	1.23	1.2	1.37	1.37	1.37	1.4	1.52	1.52	1.51	1.5	1.68	1.68	1.68	1.7	1.87	1.87	1.87	1.9	1.87	1.87	1.87	1.9	1.87	1.87	1.9
	Amps	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.2	5.9	5.9	5.9	5.9	6.6	6.6	6.6	6.7	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
600	MBh	18.5	18.7	19.3	20.1	18.3	18.6	19.1	19.9	17.9	18.1	18.6	19.5	17.0	17.3	17.8	18.7	16.1	16.3	16.9	17.7	15.2	15.4	16.0	16.8	13.5	13.8	14.3	15.1	15.6	16.3	17.2
	S/T	0.78	0.71	0.58	0.4	0.78	0.71	0.58	0.5	0.81	0.73	0.61	0.5	1.00	0.75	0.63	0.5	1.00	0.77	0.65	0.5	1.00	0.82	0.69	0.6	1.00	0.82	0.69	0.6	1.00	0.82	0.69
	ΔT	24	22	18	14	24	22	18	14	24	22	18	14	24	22	18	14	24	22	18	14	25	23	19	15	25	23	19	15	25	23	19
	kW	1.12	1.12	1.12	1.13	1.24	1.24	1.24	1.25	1.38	1.38	1.37	1.38	1.52	1.52	1.52	1.53	1.69	1.69	1.68	1.69	1.88	1.88	1.88	1.89	1.88	1.88	1.88	1.89	1.88	1.88	1.89
	Amps	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	5.9	6.7	6.7	6.6	6.7	7.5	7.5	7.5	7.6	7.5	7.5	7.5	7.6	7.5	7.5	7.6
675	MBh	18.9	19.1	19.7	20.5	18.7	19.0	19.5	20.3	18.3	18.5	19.0	19.9	17.4	17.7	18.2	19.1	16.5	16.7	17.3	18.1	15.6	15.8	16.4	17.2	13.5	13.8	14.3	15.1	15.6	16.3	17.2
	S/T	0.78	0.71	0.59	0.5	0.79	0.72	0.59	0.5	0.81	0.74	0.62	0.5	1.00	0.76	0.63	0.5	1.00	0.78	0.65	0.5	1.00	0.83	0.70	0.6	1.00	0.83	0.70	0.6	1.00	0.83	0.70
	ΔT	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	13	24	22	18	14	24	22	18	14	24	22	18
	kW	1.13	1.12	1.12	1.1	1.25	1.25	1.24	1.3	1.38	1.38	1.38	1.4	1.53	1.53	1.53	1.5	1.69	1.69	1.69	1.7	1.88	1.88	1.88	1.9	1.88	1.88	1.88	1.9	1.88	1.88	1.9
	Amps	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.7	5.3	5.3	5.3	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
IDB	AIRFLOW	ENTERING INDOOR WET BULB TEMPERATURE																																			
525	MBh	18.2	18.5	19.0	19.8	18.1	18.3	18.9	19.7	17.6	17.9	18.4	19.2	16.8	17.1	17.6	18.4	15.8	16.1	16.6	17.4	14.9	15.2	15.7	16.5												
	S/T	0.86	0.79	0.66	0.5	1.00	0.79	0.67	0.5	1.00	0.82	0.69	0.6	1.00	0.84	0.71	0.6	1.00	0.86	0.73	0.6	1.00	1.00	0.78	0.6												
	ΔT	30	28	24	20	29	27	24	20	30	28	24	20	29	27	24	20	29	27	23	19	30	28	25	21												
	kW	1.11	1.11	1.11	1.1	1.24	1.24	1.23	1.2	1.37	1.37	1.37	1.4	1.52	1.52	1.52	1.5	1.68	1.68	1.68	1.7	1.87	1.87	1.87	1.9												
	Amps	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.2	5.9	5.9	5.9	5.9	6.6	6.6	6.6	6.7	7.5	7.5	7.5	7.5												
600	MBh	18.6	18.8	19.4	20.2	18.4	18.7	19.2	20.0	17.9	18.2	18.7	19.5	17.1	17.4	17.9	18.7	16.2	16.4	16.9	17.8	15.3	15.5	16.0	16.9												
	S/T	0.89	0.82	0.70	0.6	1.00	0.83	0.70	0.6	1.00	0.85	0.72	0.6	1.00	0.87	0.74	0.6	1.00	0.89	0.76	0.6	1.00	1.00	0.81	0.7												
	ΔT	28	26	23	19	28	26	23	19	29	27	23	19	28	26	23	19	28	26	22	18	29	27	24	20												
	kW	1.12	1.12	1.12	1.13	1.24	1.24	1.24	1.25	1.38	1.38	1.37	1.38	1.52	1.52	1.52	1.53	1.69	1.69	1.68	1.69	1.88	1.88	1.88	1.89												
	Amps	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.7	5.2	5.2	5.2	5.3	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.5	7.5	7.5	7.6												
675	MBh	19.0	19.2	19.8	20.6	18.8	19.1	19.6	20.4	18.3	18.6	19.1	20.0	17.5	17.8	18.3	19.1	16.6	16.8	17.3	18.2	15.7	15.9	16.4	17.3												
	S/T	0.90	0.83	0.70	0.6	1.00	0.84	0.71	0.6	1.00	0.86	0.73	0.6	1.00	0.88	0.75	0.6	1.00	0.90	0.77	0.6	1.00	1.00	0.82	0.7												
	ΔT	27	25	22	18	27	25	22	18	28	26	22	18	27	25	21	18	27	25	21	17	28	26	22	19												
	kW	1.13	1.13	1.12	1.1	1.25	1.25	1.24	1.3	1.38	1.38	1.38	1.4	1.53	1.53	1.53	1.5	1.69	1.69	1.69	1.7	1.89	1.88	1.88	1.9												
	Amps	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.7	5.3	5.3	5.3	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6												

85	525	MBh	18.5	18.8	19.3	20.2	18.4	18.6	19.2	20.0	17.9	18.2	18.7	19.5	17.1	17.4	17.9	18.7	16.1	16.4	16.9	17.7	15.2	15.5	16.0	16.8
		S/T	1.00	0.88	0.76	0.6	1.00	0.89	0.76	0.6	1.00	0.91	0.79	0.7	1.00	1.00	0.80	0.7	1.00	1.00	0.82	0.7	1.00	1.00	0.87	0.7
		ΔT	34	31	28	24	33	31	28	24	34	32	28	24	33	31	28	24	33	31	27	23	34	32	29	25
		kW	1.12	1.12	1.11	1.1	1.24	1.24	1.24	1.2	1.37	1.37	1.37	1.4	1.52	1.52	1.52	1.5	1.68	1.68	1.68	1.7	1.88	1.88	1.87	1.9
		Amps	4.1	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	5.9	6.6	6.6	6.6	6.7	7.5	7.5	7.5	7.6
85	600	MBh	18.9	19.1	19.7	20.5	18.7	19.0	19.5	20.3	18.2	18.5	19.0	19.9	17.4	17.7	18.2	19.0	16.5	16.7	17.2	18.1	15.6	15.8	16.3	17.2
		S/T	1.00	0.92	0.79	0.7	1.00	0.92	0.80	0.7	1.00	0.95	0.82	0.7	1.00	1.00	0.84	0.7	1.00	1.00	0.86	0.7	1.00	1.00	0.91	0.8
		ΔT	32	30	27	23	32	30	26	23	33	31	27	23	32	30	26	23	32	30	26	22	33	31	27	24
		kW	1.12	1.12	1.12	1.13	1.24	1.24	1.24	1.25	1.38	1.38	1.38	1.39	1.53	1.53	1.52	1.53	1.69	1.69	1.69	1.70	1.88	1.88	1.88	1.89
		Amps	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.7	5.3	5.3	5.2	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.5	7.6
675	MBh	19.3	19.5	20.1	20.9	19.1	19.4	19.9	20.7	18.6	18.9	19.4	20.3	17.8	18.1	18.6	19.4	16.9	17.1	17.6	18.5	16.0	16.2	16.8	17.6	
	S/T	1.00	0.92	0.80	0.7	1.00	0.93	0.80	0.7	1.00	1.00	0.83	0.7	1.00	1.00	0.84	0.7	1.00	1.00	0.87	0.7	1.00	1.00	0.91	0.8	
	ΔT	31	29	26	22	31	29	25	22	32	30	26	22	31	29	25	22	31	29	25	21	32	30	26	23	
	kW	1.13	1.13	1.13	1.1	1.25	1.25	1.25	1.3	1.39	1.38	1.38	1.4	1.53	1.53	1.53	1.5	1.70	1.69	1.69	1.7	1.89	1.89	1.88	1.9	
	Amps	4.1	4.1	4.1	4.1	4.7	4.7	4.6	4.7	5.3	5.3	5.3	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
IDB	AIRFLOW	ENTERING INDOOR WET BULB TEMPERATURE																																			
70	MBh	24.3	24.7	25.4	-	24.1	24.4	25.2	-	23.5	23.8	24.5	-	22.4	22.7	23.5	-	21.1	21.4	22.1	-	19.9	20.2	20.9	-												
	S/T	0.63	0.56	0.43	-	0.63	0.56	0.43	-	0.66	0.59	0.46	-	1.00	0.60	0.48	-	1.00	0.62	0.50	-	1.00	0.67	0.55	-												
	ΔT	21	19	15	-	21	19	15	-	21	19	15	-	21	19	15	-	20	18	15	-	22	20	16	-												
	kW	1.49	1.49	1.48	-	1.65	1.65	1.65	-	1.84	1.84	1.83	-	2.04	2.03	2.03	-	2.26	2.26	2.25	-	2.52	2.52	2.52	-												
	Amps	5.4	5.4	5.4	-	6.2	6.1	6.1	-	7.0	7.0	7.0	-	7.9	7.9	7.9	-	8.9	8.9	8.9	-	10.1	10.1	10.1	-												
800	MBh	24.8	25.1	25.8	-	24.5	24.9	25.6	-	23.9	24.3	25.0	-	22.8	23.2	23.9	-	21.5	21.9	22.6	-	20.3	20.7	21.4	-												
	S/T	0.66	0.59	0.46	-	0.67	0.60	0.47	-	0.69	0.62	0.49	-	1.00	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-												
	ΔT	20	17	14	-	19	17	14	-	20	18	14	-	19	17	14	-	19	17	13	-	20	18	15	-												
	kW	1.50	1.49	1.49	-	1.66	1.66	1.66	-	1.85	1.84	1.84	-	2.04	2.04	2.04	-	2.27	2.27	2.26	-	2.53	2.53	2.52	-												
	Amps	5.4	5.4	5.4	-	6.2	6.2	6.2	-	7.0	7.0	7.0	-	7.9	7.9	7.9	-	9.0	9.0	8.9	-	10.2	10.2	10.1	-												
900	MBh	25.3	25.6	26.4	-	25.1	25.4	26.1	-	24.5	24.8	25.5	-	23.4	23.7	24.4	-	22.1	22.4	23.1	-	20.9	21.2	21.9	-												
	S/T	0.67	0.60	0.47	-	0.68	0.60	0.48	-	1.00	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.67	0.54	-	1.00	1.00	0.59	-												
	ΔT	18	16	13	-	18	16	13	-	19	17	13	-	18	16	13	-	18	16	12	-	19	17	14	-												
	kW	1.50	1.50	1.50	-	1.67	1.67	1.66	-	1.85	1.85	1.85	-	2.05	2.05	2.05	-	2.27	2.27	2.27	-	2.54	2.53	2.53	-												
	Amps	5.5	5.5	5.4	-	6.2	6.2	6.2	-	7.1	7.1	7.0	-	8.0	8.0	8.0	-	9.0	9.0	9.0	-	10.2	10.2	10.2	-												

700	MBh	24.3	24.7	25.4	26.5	24.1	24.5	25.2	26.3	23.5	23.8	24.6	25.6	22.4	22.8	23.5	24.6	21.1	21.4	22.2	23.3	19.9	20.2	21.0	22.0
	S/T	0.75	0.68	0.55	0.4	0.76	0.68	0.56	0.4	1.00	0.71	0.58	0.4	1.00	0.73	0.60	0.5	1.00	0.75	0.62	0.5	1.00	1.00	0.67	0.5
	ΔT	25	23	19	15	25	23	19	15	25	23	20	16	25	23	19	15	25	23	19	15	26	24	20	16
	kW	1.49	1.49	1.48	1.5	1.65	1.65	1.65	1.7	1.84	1.83	1.83	1.8	2.04	2.03	2.03	2.0	2.26	2.26	2.25	2.3	2.52	2.52	2.51	2.5
	Amps	5.4	5.4	5.4	5.4	6.1	6.1	6.1	6.2	7.0	7.0	7.0	7.0	7.9	7.9	7.9	7.9	8.9	8.9	8.9	9.0	10.1	10.1	10.1	10.2
800	MBh	24.8	25.1	25.8	26.9	24.6	24.9	25.6	26.7	23.9	24.3	25.0	26.1	22.9	23.2	23.9	25.0	21.5	21.9	22.6	23.7	20.3	20.7	21.4	22.5
	S/T	0.78	0.71	0.58	0.4	1.00	0.72	0.59	0.5	1.00	0.74	0.61	0.5	1.00	0.76	0.63	0.5	1.00	0.78	0.65	0.5	1.00	1.00	0.70	0.6
	ΔT	24	22	18	14	24	22	18	14	24	22	18	14	24	22	18	14	24	22	18	14	25	23	19	15
	kW	1.50	1.49	1.49	1.50	1.66	1.66	1.66	1.67	1.84	1.84	1.84	1.85	2.04	2.04	2.04	2.05	2.27	2.26	2.26	2.27	2.53	2.53	2.52	2.54
	Amps	5.4	5.4	5.4	5.5	6.2	6.2	6.2	6.2	7.0	7.0	7.0	7.1	7.9	7.9	7.9	8.0	9.0	9.0	8.9	9.0	10.2	10.1	10.1	10.2
900	MBh	25.3	25.7	26.4	27.5	25.1	25.4	26.2	27.3	24.5	24.8	25.5	26.6	23.4	23.7	24.5	25.6	22.1	22.4	23.1	24.2	20.9	21.2	21.9	23.0
	S/T	0.79	0.72	0.59	0.5	1.00	0.73	0.60	0.5	1.00	0.75	0.62	0.5	1.00	0.77	0.64	0.5	1.00	1.00	0.66	0.5	1.00	1.00	0.71	0.6
	ΔT	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	13	24	22	18	14
	kW	1.50	1.50	1.50	1.5	1.67	1.67	1.66	1.7	1.85	1.85	1.85	1.9	2.05	2.05	2.05	2.1	2.27	2.27	2.27	2.3	2.53	2.53	2.53	2.5
	Amps	5.5	5.5	5.4	5.5	6.2	6.2	6.2	6.3	7.1	7.1	7.0	7.1	8.0	8.0	8.0	8.0	9.0	9.0	9.0	9.0	10.2	10.2	10.2	10.2

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

			OUTDOOR AMBIENT TEMPERATURE																																			
			65						75						85						95						105						115					
			ENTERING INDOOR WET BULB TEMPERATURE																																			
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71									
80		MBh	24.5	24.8	25.5	26.6	24.2	24.6	25.3	26.4	23.6	24.0	24.7	25.8	22.5	22.9	23.6	24.7	21.2	21.6	22.3	23.4	20.0	20.4	21.1	22.2	20.0	20.4	21.1	22.2								
	700	S/T	1.00	0.80	0.67	0.5	1.00	0.80	0.67	0.5	1.00	0.83	0.70	0.6	1.00	1.00	0.72	0.6	1.00	1.00	0.74	0.6	1.00	1.00	0.79	0.7	1.00	1.00	0.79	0.7								
		ΔT	30	28	24	20	30	28	24	20	30	28	24	20	30	28	24	20	29	27	23	20	31	29	25	21	31	29	25	21								
		kW	1.49	1.49	1.48	1.5	1.65	1.65	1.65	1.7	1.84	1.84	1.83	1.8	2.04	2.03	2.03	2.0	2.26	2.26	2.25	2.3	2.52	2.52	2.52	2.5	2.52	2.52	2.52	2.5								
		Amps	5.4	5.4	5.4	5.4	6.2	6.1	6.1	6.2	7.0	7.0	7.0	7.0	7.9	7.9	7.9	7.9	8.9	8.9	8.9	9.0	10.1	10.1	10.1	10.2	10.1	10.1	10.1	10.2								
800		MBh	24.9	25.2	26.0	27.1	24.7	25.0	25.7	26.8	24.1	24.4	25.1	26.2	23.0	23.3	24.0	25.1	21.7	22.0	22.7	23.8	20.5	20.8	21.5	22.6	20.5	20.8	21.5	22.6								
	800	S/T	1.00	0.83	0.70	0.6	1.00	0.84	0.71	0.6	1.00	0.86	0.73	0.6	1.00	1.00	0.75	0.6	1.00	1.00	0.77	0.6	1.00	1.00	0.82	0.7	1.00	1.00	0.82	0.7								
		ΔT	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	28	26	22	18	29	27	24	20	29	27	24	20								
		kW	1.50	1.49	1.49	1.50	1.66	1.66	1.66	1.67	1.85	1.84	1.84	1.85	2.04	2.04	2.04	2.05	2.27	2.27	2.26	2.28	2.53	2.53	2.52	2.54	2.53	2.53	2.52	2.54								
		Amps	5.4	5.4	5.4	5.5	6.2	6.2	6.2	6.2	7.0	7.0	7.0	7.1	7.9	7.9	7.9	8.0	9.0	9.0	8.9	9.0	10.2	10.1	10.1	10.2	10.2	10.1	10.1	10.2								
900		MBh	25.4	25.8	26.5	27.6	25.2	25.6	26.3	27.4	24.6	24.9	25.7	26.8	23.5	23.9	24.6	25.7	22.2	22.5	23.3	24.4	21.0	21.3	22.1	23.2	21.0	21.3	22.1	23.2								
	900	S/T	1.00	0.84	0.71	0.6	1.00	0.84	0.72	0.6	1.00	1.00	0.74	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.6	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.7								
		ΔT	27	25	22	18	27	25	22	18	28	26	22	18	27	25	22	18	27	25	21	17	28	26	23	19	27	25	21	17								
		kW	1.50	1.50	1.50	1.5	1.67	1.67	1.66	1.7	1.85	1.85	1.85	1.9	2.05	2.05	2.05	2.1	2.27	2.27	2.27	2.3	2.53	2.53	2.53	2.5	2.53	2.53	2.53	2.5								
		Amps	5.5	5.5	5.4	5.5	6.2	6.2	6.2	6.3	7.1	7.1	7.0	7.1	8.0	8.0	8.0	8.0	9.0	9.0	9.0	9.0	10.2	10.2	10.2	10.2	10.2	10.2	10.2	10.2								
85		MBh	24.9	25.2	25.9	27.0	24.7	25.0	25.7	26.8	24.0	24.4	25.1	26.2	22.9	23.3	24.0	25.1	21.6	22.0	22.7	23.8	20.4	20.8	21.5	22.6	20.4	20.8	21.5	22.6								
	700	S/T	1.00	0.89	0.76	0.6	1.00	1.00	0.77	0.6	1.00	1.00	0.79	0.7	1.00	1.00	0.81	0.7	1.00	1.00	0.83	0.7	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.7								
		ΔT	34	32	28	24	34	32	28	24	34	32	28	24	34	31	28	24	33	31	27	24	35	32	29	25	35	32	29	25								
		kW	1.49	1.49	1.49	1.5	1.66	1.65	1.65	1.7	1.84	1.84	1.84	1.8	2.04	2.04	2.04	2.0	2.26	2.26	2.26	2.3	2.52	2.52	2.52	2.5	2.52	2.52	2.52	2.5								
		Amps	5.4	5.4	5.4	5.4	6.2	6.2	6.1	6.2	7.0	7.0	7.0	7.0	7.9	7.9	7.9	8.0	8.9	8.9	8.9	9.0	10.1	10.1	10.1	10.2	10.1	10.1	10.1	10.2								
85		MBh	25.3	25.6	26.4	27.5	25.1	25.4	26.1	27.2	24.5	24.8	25.5	26.6	23.4	23.7	24.4	25.5	22.1	22.4	23.1	24.2	20.9	21.2	21.9	23.0	20.9	21.2	21.9	23.0								
	800	S/T	1.00	0.93	0.80	0.7	1.00	1.00	0.80	0.7	1.00	1.00	0.83	0.7	1.00	1.00	0.85	0.7	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.8	1.00	1.00	1.00	0.8								
		ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	22	33	31	28	24	33	31	28	24								
		kW	1.50	1.50	1.50	1.51	1.66	1.66	1.66	1.67	1.85	1.85	1.84	1.86	2.05	2.05	2.04	2.06	2.27	2.27	2.27	2.28	2.53	2.53	2.53	2.54	2.53	2.53	2.53	2.54								
		Amps	5.4	5.4	5.4	5.5	6.2	6.2	6.2	6.2	7.0	7.0	7.0	7.1	8.0	7.9	7.9	8.0	9.0	9.0	9.0	9.0	10.2	10.2	10.2	10.2	10.2	10.2	10.2	10.2								
900		MBh	25.8	26.2	26.9	28.0	25.6	26.0	26.7	27.8	25.0	25.3	26.1	27.2	23.9	24.3	25.0	26.1	22.6	22.9	23.7	24.8	21.4	21.7	22.5	23.6	21.4	21.7	22.5	23.6								
	900	S/T	1.00	0.93	0.81	0.7	1.00	1.00	0.81	0.7	1.00	1.00	0.83	0.7	1.00	1.00	0.85	0.7	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.8	1.00	1.00	1.00	0.8								
		ΔT	31	29	26	22	31	29	26	22	32	30	26	22	31	29	26	22	31	29	25	21	32	30	27	23	32	30	27	23								
		kW	1.51	1.50	1.50	1.5	1.67	1.67	1.67	1.7	1.86	1.85	1.85	1.9	2.05	2.05	2.05	2.1	2.28	2.28	2.27	2.3	2.54	2.54	2.53	2.5	2.54	2.54	2.53	2.5								
		Amps	5.5	5.5	5.5	5.5	6.2	6.2	6.2	6.3	7.1	7.1	7.1	7.1	8.0	8.0	8.0	8.0	9.0	9.0	9.0	9.0	10.2	10.2	10.2	10.2	10.2	10.2	10.2	10.2								
			Shaded area reflects AHRI conditions																								kW = Total system power Amps = outdoor unit amps (comp.+fan)											
			IDB: Entering Indoor Dry Bulb Temperature																																			
			High and low pressures are measured at the liquid and suction service valves.																																			

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																							
		65								75								85							
		105				115				105				115				105				115			
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	29.5	29.9	30.8	-	29.2	29.6	30.5	-	28.5	28.9	29.7	-	27.2	27.6	28.4	-	25.6	26.0	26.8	-	24.1	24.5	25.4	-
	S/T	0.64	0.57	0.44	-	0.65	0.57	0.44	-	0.67	0.60	0.47	-	0.69	0.62	0.49	-	0.71	0.64	0.51	-	0.76	0.69	0.56	-
	ΔT	20	18	14	-	20	18	14	-	20	18	15	-	20	18	14	-	20	18	14	-	21	19	15	-
	kW	1.81	1.81	1.81	-	2.01	2.01	2.01	-	2.23	2.23	2.22	-	2.47	2.47	2.46	-	2.73	2.73	2.73	-	3.04	3.04	3.04	-
	Amps	6.5	6.5	6.5	-	7.4	7.4	7.4	-	8.4	8.4	8.4	-	9.5	9.5	9.5	-	10.7	10.7	10.7	-	12.1	12.1	12.1	-
1000	MBh	29.9	30.3	31.2	-	29.6	30.0	30.9	-	28.9	29.3	30.1	-	27.6	28.0	28.8	-	26.0	26.4	27.2	-	24.5	24.9	25.8	-
	S/T	0.67	0.60	0.47	-	0.68	0.60	0.47	-	0.70	0.63	0.50	-	0.72	0.65	0.52	-	0.74	0.67	0.54	-	1.00	0.72	0.59	-
	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	19	17	13	-	20	18	14	-
	kW	1.82	1.82	1.82	-	2.02	2.02	2.01	-	2.24	2.24	2.23	-	2.48	2.47	2.47	-	2.74	2.74	2.74	-	3.05	3.05	3.05	-
	Amps	6.5	6.5	6.5	-	7.4	7.4	7.4	-	8.4	8.4	8.4	-	9.5	9.5	9.5	-	10.7	10.7	10.7	-	12.2	12.1	12.1	-
1125	MBh	30.5	30.9	31.8	-	30.2	30.6	31.5	-	29.5	29.9	30.7	-	28.2	28.6	29.4	-	26.6	27.0	27.8	-	25.1	25.5	26.4	-
	S/T	0.68	0.61	0.48	-	0.69	0.62	0.49	-	0.71	0.64	0.51	-	0.73	0.66	0.53	-	0.75	0.68	0.55	-	1.00	0.73	0.60	-
	ΔT	18	16	12	-	18	16	12	-	18	16	13	-	18	16	12	-	18	16	12	-	19	17	13	-
	kW	1.83	1.83	1.82	-	2.03	2.02	2.02	-	2.25	2.24	2.24	-	2.48	2.48	2.48	-	2.75	2.75	2.74	-	3.06	3.06	3.06	-
	Amps	6.6	6.5	6.5	-	7.5	7.4	7.4	-	8.5	8.5	8.4	-	9.5	9.5	9.5	-	10.8	10.8	10.7	-	12.2	12.2	12.2	-

75	MBh	29.5	29.9	30.8	32.1	29.2	29.6	30.5	31.8	28.5	28.9	29.8	31.1	27.2	27.6	28.4	29.8	25.6	26.0	26.9	28.2	24.1	24.5	25.4	26.7
	S/T	0.76	0.69	0.56	0.4	0.77	0.70	0.57	0.4	0.79	0.72	0.59	0.5	0.81	0.74	0.61	0.5	1.00	0.76	0.63	0.5	1.00	0.81	0.68	0.5
	ΔT	24	22	19	15	24	22	19	15	24	23	19	15	24	22	19	15	24	22	18	15	25	23	20	16
	kW	1.81	1.81	1.81	1.8	2.01	2.01	2.00	2.0	2.23	2.23	2.22	2.2	2.47	2.46	2.46	2.5	2.73	2.73	2.73	2.7	3.04	3.04	3.04	3.1
	Amps	6.5	6.5	6.5	6.5	7.4	7.4	7.4	7.4	8.4	8.4	8.4	8.4	9.5	9.5	9.4	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2
1000	MBh	29.9	30.3	31.2	32.5	29.6	30.1	30.9	32.2	28.9	29.3	30.2	31.5	27.6	28.0	28.9	30.2	26.0	26.4	27.3	28.6	24.5	24.9	25.8	27.1
	S/T	0.79	0.72	0.59	0.5	0.80	0.73	0.60	0.5	0.82	0.75	0.62	0.5	0.84	0.77	0.64	0.5	1.00	0.79	0.66	0.5	1.00	0.84	0.71	0.6
	ΔT	23	21	18	14	23	21	18	14	24	22	18	14	23	21	18	14	23	21	17	14	24	22	19	15
	kW	1.82	1.82	1.81	1.83	2.02	2.01	2.01	2.03	2.24	2.23	2.23	2.25	2.47	2.47	2.47	2.48	2.74	2.74	2.73	2.75	3.05	3.05	3.05	3.06
	Amps	6.5	6.5	6.5	6.6	7.4	7.4	7.4	7.5	8.4	8.4	8.4	8.5	9.5	9.5	9.5	9.6	10.7	10.7	10.7	10.8	12.1	12.1	12.1	12.2
1125	MBh	30.5	30.9	31.8	33.1	30.2	30.7	31.5	32.9	29.5	29.9	30.8	32.1	28.2	28.6	29.5	30.8	26.6	27.0	27.9	29.2	25.1	25.5	26.4	27.7
	S/T	0.81	0.73	0.60	0.5	0.81	0.74	0.61	0.5	0.84	0.76	0.63	0.5	1.00	0.78	0.65	0.5	1.00	0.80	0.67	0.5	1.00	0.85	0.72	0.6
	ΔT	22	20	17	13	22	20	17	13	23	21	17	13	22	20	17	13	22	20	16	13	23	21	18	14
	kW	1.83	1.83	1.82	1.8	2.02	2.02	2.02	2.0	2.24	2.24	2.24	2.3	2.48	2.48	2.48	2.5	2.75	2.75	2.74	2.8	3.06	3.06	3.05	3.1
	Amps	6.6	6.5	6.5	6.6	7.5	7.4	7.4	7.5	8.5	8.4	8.4	8.5	9.5	9.5	9.5	9.6	10.8	10.8	10.7	10.8	12.2	12.2	12.2	12.2

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																								
		65								75								85								
		105								115																
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	900	MBh	29.6	30.1	30.9	32.3	29.4	29.8	30.7	32.0	28.6	29.0	29.9	31.2	27.3	27.7	28.6	29.9	25.7	26.1	27.0	28.3	24.3	24.7	25.5	26.9
		S/T	0.89	0.81	0.68	0.5	0.89	0.82	0.69	0.6	1.00	0.84	0.71	0.6	1.00	0.86	0.73	0.6	1.00	0.88	0.75	0.6	1.00	0.93	0.80	0.7
		ΔT	29	27	23	19	29	27	23	19	29	27	23	19	28	27	23	19	28	26	23	19	29	28	24	20
		kW	1.81	1.81	1.81	1.8	2.01	2.01	2.00	2.0	2.23	2.23	2.22	2.2	2.47	2.47	2.46	2.5	2.73	2.73	2.73	2.7	3.04	3.04	3.04	3.1
		Amps	6.5	6.5	6.5	6.5	7.4	7.4	7.4	7.4	8.4	8.4	8.4	8.4	9.5	9.5	9.5	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2
	1000	MBh	30.1	30.5	31.3	32.7	29.8	30.2	31.1	32.4	29.0	29.4	30.3	31.6	27.7	28.1	29.0	30.3	26.1	26.5	27.4	28.7	24.7	25.1	25.9	27.3
		S/T	0.92	0.84	0.71	0.6	0.92	0.85	0.72	0.6	1.00	0.87	0.74	0.6	1.00	0.89	0.76	0.6	1.00	0.91	0.78	0.6	1.00	0.96	0.83	0.7
		ΔT	28	26	22	18	28	26	22	18	28	26	22	19	28	26	22	18	27	25	22	18	29	27	23	19
		kW	1.82	1.82	1.82	1.83	2.02	2.02	2.01	2.03	2.24	2.24	2.23	2.25	2.47	2.47	2.47	2.48	2.74	2.74	2.74	2.75	3.05	3.05	3.05	3.06
		Amps	6.5	6.5	6.5	6.6	7.4	7.4	7.4	7.5	8.4	8.4	8.4	8.5	9.5	9.5	9.5	9.6	10.7	10.7	10.7	10.8	12.2	12.1	12.1	12.2
	1125	MBh	30.7	31.1	31.9	33.3	30.4	30.8	31.7	33.0	29.6	30.0	30.9	32.2	28.3	28.7	29.6	30.9	26.7	27.1	28.0	29.3	25.3	25.7	26.6	27.9
		S/T	0.93	0.86	0.72	0.6	1.00	0.86	0.73	0.6	1.00	0.89	0.75	0.6	1.00	0.90	0.77	0.6	1.00	0.93	0.79	0.7	1.00	1.00	0.84	0.7
		ΔT	27	25	21	17	27	25	21	17	27	25	21	18	27	25	21	17	26	24	21	17	28	26	22	18
		kW	1.83	1.83	1.82	1.8	2.03	2.02	2.02	2.0	2.25	2.24	2.24	2.3	2.48	2.48	2.48	2.5	2.75	2.75	2.74	2.8	3.06	3.06	3.06	3.1
		Amps	6.6	6.5	6.5	6.6	7.5	7.4	7.4	7.5	8.5	8.5	8.4	8.5	9.5	9.5	9.5	9.6	10.8	10.8	10.7	10.8	12.2	12.2	12.2	12.2
85	900	MBh	30.1	30.5	31.4	32.7	29.9	30.3	31.2	32.5	29.1	29.5	30.4	31.7	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.8	25.2	26.0	27.4
		S/T	1.00	0.91	0.78	0.6	1.00	0.92	0.78	0.6	1.00	0.94	0.81	0.7	1.00	0.96	0.83	0.7	1.00	1.00	0.85	0.7	1.00	1.00	0.90	0.8
		ΔT	32	30	27	23	32	30	27	23	33	31	27	23	32	30	27	23	32	30	26	23	33	31	28	24
		kW	1.82	1.82	1.81	1.8	2.01	2.01	2.01	2.0	2.23	2.23	2.23	2.2	2.47	2.47	2.47	2.5	2.74	2.73	2.73	2.7	3.05	3.05	3.04	3.1
		Amps	6.5	6.5	6.5	6.5	7.4	7.4	7.4	7.4	8.4	8.4	8.4	8.5	9.5	9.5	9.5	9.5	10.7	10.7	10.7	10.8	12.1	12.1	12.1	12.2
	1000	MBh	30.5	31.0	31.8	33.1	30.3	30.7	31.6	32.9	29.5	29.9	30.8	32.1	28.2	28.6	29.5	30.8	26.6	27.0	27.9	29.2	25.2	25.6	26.4	27.8
		S/T	1.00	0.94	0.81	0.7	1.00	0.95	0.81	0.7	1.00	0.97	0.84	0.7	1.00	1.00	0.86	0.7	1.00	1.00	0.88	0.7	1.00	1.00	0.93	0.8
		ΔT	32	30	26	22	31	30	26	22	32	30	26	22	31	29	26	22	31	29	26	22	32	30	27	23
		kW	1.82	1.82	1.82	1.83	2.02	2.02	2.02	2.03	2.24	2.24	2.24	2.25	2.48	2.48	2.47	2.49	2.74	2.74	2.74	2.75	3.06	3.05	3.05	3.07
		Amps	6.5	6.5	6.5	6.6	7.4	7.4	7.4	7.5	8.4	8.4	8.4	8.5	9.5	9.5	9.5	9.6	10.7	10.7	10.7	10.8	12.2	12.2	12.1	12.2
	1125	MBh	31.1	31.6	32.4	33.8	30.9	31.3	32.2	33.5	30.1	30.5	31.4	32.7	28.8	29.2	30.1	31.4	27.2	27.6	28.5	29.8	25.8	26.2	27.0	28.4
		S/T	1.00	0.95	0.82	0.7	1.00	0.96	0.83	0.7	1.00	0.98	0.85	0.7	1.00	1.00	0.87	0.7	1.00	1.00	0.89	0.8	1.00	1.00	0.94	0.8
		ΔT	31	29	25	21	30	29	25	21	31	29	25	21	30	29	25	21	30	28	25	21	31	29	26	22
		kW	1.83	1.83	1.83	1.8	2.03	2.03	2.02	2.0	2.25	2.25	2.24	2.3	2.49	2.49	2.48	2.5	2.75	2.75	2.75	2.8	3.06	3.06	3.06	3.1
		Amps	6.6	6.6	6.5	6.6	7.5	7.5	7.5	7.5	8.5	8.5	8.5	8.5	9.6	9.6	9.5	9.6	10.8	10.8	10.8	10.8	12.2	12.2	12.2	12.3

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
IDB	AIRFLOW	ENTERING INDOOR WET BULB TEMPERATURE																																			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
70		MBh	35.3	35.7	36.8	-	34.9	35.4	36.5	-	34.0	34.5	35.6	-	32.4	32.9	34.0	-	30.5	31.0	32.1	-	28.7	29.2	30.3	-											
	1050	S/T	0.61	0.54	0.40	-	0.62	0.54	0.41	-	0.65	0.57	0.43	-	1.00	0.59	0.45	-	1.00	0.61	0.48	-	1.00	0.66	0.53	-											
		ΔT	20	18	15	-	20	18	15	-	21	19	15	-	20	18	15	-	20	18	15	-	21	19	16	-											
		kW	2.18	2.18	2.18	-	2.42	2.42	2.42	-	2.69	2.68	2.68	-	2.97	2.97	2.97	-	3.30	3.29	3.29	-	3.67	3.67	3.67	-											
		Amps	7.6	7.6	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.2	-	12.7	12.7	12.7	-	14.4	14.4	14.4	-											
		MBh	35.7	36.2	37.2	-	35.3	35.8	36.9	-	34.4	34.9	36.0	-	32.8	33.3	34.4	-	30.9	31.4	32.5	-	29.2	29.6	30.7	-											
	1180	S/T	0.67	0.59	0.45	-	0.67	0.60	0.46	-	0.70	0.62	0.49	-	1.00	0.64	0.50	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-											
		ΔT	19	17	14	-	19	17	14	-	20	18	14	-	19	17	14	-	19	17	14	-	20	18	15	-											
		kW	2.19	2.19	2.19	-	2.43	2.43	2.43	-	2.70	2.70	2.69	-	2.98	2.98	2.98	-	3.31	3.30	3.30	-	3.68	3.68	3.68	-											
		Amps	7.6	7.6	7.6	-	8.7	8.7	8.7	-	10.0	9.9	9.9	-	11.3	11.3	11.2	-	12.7	12.7	12.7	-	14.5	14.5	14.4	-											
		MBh	36.3	36.8	37.9	-	36.0	36.5	37.5	-	35.1	35.6	36.6	-	33.5	34.0	35.0	-	31.6	32.1	33.1	-	29.8	30.3	31.3	-											
	1350	S/T	0.70	0.63	0.49	-	0.71	0.63	0.50	-	1.00	0.66	0.52	-	1.00	0.68	0.54	-	1.00	0.70	0.56	-	1.00	1.00	0.62	-											
		ΔT	18	16	13	-	18	16	13	-	18	17	13	-	18	16	13	-	18	16	13	-	19	17	14	-											
		kW	2.21	2.20	2.20	-	2.44	2.44	2.44	-	2.71	2.71	2.70	-	3.00	2.99	2.99	-	3.32	3.32	3.31	-	3.69	3.69	3.69	-											
		Amps	7.7	7.7	7.7	-	8.8	8.8	8.8	-	10.0	10.0	10.0	-	11.3	11.3	11.3	-	12.8	12.8	12.8	-	14.5	14.5	14.5	-											

75	1050	MBh	35.3	35.8	36.8	38.4	35.0	35.5	36.5	38.1	34.0	34.5	35.6	37.2	32.5	33.0	34.0	35.6	30.5	31.0	32.1	33.7	28.8	29.3	30.3	31.9
		S/T	0.74	0.67	0.53	0.4	1.00	0.67	0.54	0.4	1.00	0.70	0.56	0.4	1.00	0.72	0.58	0.4	1.00	0.74	0.60	0.5	1.00	1.00	0.66	0.5
		ΔT	25	23	19	15	24	23	19	15	25	23	19	16	24	23	19	15	24	22	19	15	25	24	20	16
		kW	2.18	2.18	2.18	2.2	2.42	2.42	2.41	2.4	2.69	2.68	2.68	2.7	2.97	2.97	2.97	3.0	3.29	3.29	3.29	3.3	3.67	3.67	3.66	3.7
		Amps	7.6	7.6	7.6	7.6	8.7	8.7	8.7	8.7	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.3	12.7	12.7	12.7	12.7	14.4	14.4	14.4	14.5
	1180	MBh	35.7	36.2	37.2	38.8	35.4	35.9	36.9	38.5	34.5	34.9	36.0	37.6	32.9	33.4	34.4	36.0	30.9	31.4	32.5	34.1	29.2	29.7	30.7	32.3
		S/T	0.79	0.72	0.58	0.4	1.00	0.72	0.59	0.4	1.00	0.75	0.61	0.5	1.00	0.77	0.63	0.5	1.00	1.00	0.66	0.5	1.00	1.00	0.71	0.6
		ΔT	24	22	18	14	23	22	18	14	24	22	18	15	23	22	18	14	23	21	18	14	24	23	19	15
		kW	2.19	2.19	2.19	2.20	2.43	2.43	2.42	2.44	2.70	2.69	2.69	2.71	2.98	2.98	2.98	3.00	3.30	3.30	3.30	3.32	3.68	3.68	3.68	3.69
		Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	9.9	9.9	9.9	10.0	11.3	11.3	11.2	11.3	12.7	12.7	12.7	12.8	14.5	14.4	14.4	14.5
	1350	MBh	36.3	36.8	37.9	39.5	36.0	36.5	37.6	39.2	35.1	35.6	36.6	38.3	33.5	34.0	35.1	36.7	31.6	32.1	33.1	34.7	29.8	30.3	31.4	33.0
		S/T	0.83	0.76	0.62	0.5	1.00	0.76	0.63	0.5	1.00	0.79	0.65	0.5	1.00	0.81	0.67	0.5	1.00	1.00	0.69	0.6	1.00	1.00	0.74	0.6
		ΔT	22	21	17	13	22	20	17	13	23	21	17	14	22	20	17	13	22	20	17	13	23	21	18	14
		kW	2.20	2.20	2.20	2.2	2.44	2.44	2.44	2.5	2.71	2.71	2.70	2.7	3.00	2.99	2.99	3.0	3.32	3.31	3.31	3.3	3.69	3.69	3.69	3.7
		Amps	7.7	7.7	7.7	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.1	11.3	11.3	11.3	11.4	12.8	12.8	12.8	12.8	14.5	14.5	14.5	14.6

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80		35.5	36.0	37.0	38.6	35.1	35.6	36.7	38.3	34.2	34.7	35.8	37.4	32.6	33.1	34.2	35.8	30.7	31.2	32.3	33.9	28.9	29.4	30.5	32.1	
		1.00	0.79	0.66	0.5	1.00	0.80	0.66	0.5	1.00	0.82	0.69	0.5	1.00	1.00	0.71	0.6	1.00	1.00	0.73	0.6	1.00	1.00	0.78	0.6	
	1050	ΔT	29	27	23	20	29	27	23	20	29	27	24	20	29	27	23	20	28	27	23	19	30	28	24	20
		kW	2.18	2.18	2.18	2.2	2.42	2.42	2.41	2.4	2.69	2.68	2.68	2.7	2.97	2.97	2.97	3.0	3.30	3.29	3.29	3.3	3.67	3.67	3.67	3.7
		Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.3	12.7	12.7	12.7	12.7	14.4	14.4	14.4	14.5
80		35.9	36.4	37.4	39.0	35.6	36.0	37.1	38.7	34.6	35.1	36.2	37.8	33.1	33.5	34.6	36.2	31.1	31.6	32.7	34.3	29.4	29.9	30.9	32.5	
		1.00	0.84	0.71	0.6	1.00	0.85	0.71	0.6	1.00	0.88	0.74	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.6	1.00	1.00	0.83	0.7	
	1180	ΔT	28	26	22	19	28	26	22	19	28	26	23	19	28	26	22	19	27	26	22	18	29	27	23	19
		kW	2.19	2.19	2.19	2.21	2.43	2.43	2.43	2.44	2.70	2.70	2.69	2.71	2.98	2.98	2.98	3.00	3.31	3.30	3.30	3.32	3.68	3.68	3.68	3.70
		Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	10.0	9.9	9.9	10.0	11.3	11.3	11.2	11.3	12.7	12.7	12.7	12.8	14.5	14.5	14.4	14.5
1350		36.5	37.0	38.1	39.7	36.2	36.7	37.7	39.4	35.3	35.8	36.8	38.4	33.7	34.2	35.2	36.9	31.8	32.3	33.3	34.9	30.0	30.5	31.6	33.2	
		1.00	0.88	0.75	0.6	1.00	0.89	0.75	0.6	1.00	1.00	0.78	0.6	1.00	1.00	0.80	0.7	1.00	1.00	0.82	0.7	1.00	1.00	1.00	0.7	
	ΔT	27	25	21	18	27	25	21	17	27	25	21	18	27	25	21	17	26	24	21	17	27	26	22	18	
		kW	2.21	2.20	2.20	2.2	2.44	2.44	2.44	2.5	2.71	2.71	2.70	2.7	3.00	2.99	2.99	3.0	3.32	3.32	3.31	3.3	3.69	3.69	3.69	3.7
		Amps	7.7	7.7	7.7	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.1	11.3	11.3	11.3	11.4	12.8	12.8	12.8	12.8	14.5	14.5	14.5	14.6

85	1050	MBh	36.0	36.5	37.6	39.2	35.7	36.2	37.3	38.9	34.8	35.3	36.4	38.0	33.2	33.7	34.8	36.4	31.3	31.8	32.8	34.5	29.5	30.0	31.1	32.7
		S/T	1.00	0.89	0.76	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.79	0.6	1.00	1.00	0.81	0.7	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.7
		ΔT	32	31	27	23	32	31	27	23	33	31	27	24	32	30	27	23	32	30	27	23	33	31	28	24
		kW	2.19	2.19	2.18	2.2	2.43	2.42	2.42	2.4	2.69	2.69	2.69	2.7	2.98	2.98	2.97	3.0	3.30	3.30	3.29	3.3	3.68	3.67	3.67	3.7
		Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.3	12.7	12.7	12.7	12.8	14.4	14.4	14.4	14.5
	1180	MBh	36.5	37.0	38.0	39.6	36.1	36.6	37.7	39.3	35.2	35.7	36.8	38.4	33.6	34.1	35.2	36.8	31.7	32.2	33.3	34.9	29.9	30.4	31.5	33.1
		S/T	1.00	0.95	0.81	0.7	1.00	1.00	0.82	0.7	1.00	1.00	0.84	0.7	1.00	1.00	0.86	0.7	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.8
		ΔT	31	30	26	22	31	30	26	22	32	30	26	23	31	29	26	22	31	29	26	22	32	30	27	23
		kW	2.20	2.20	2.19	2.21	2.44	2.43	2.43	2.45	2.70	2.70	2.70	2.71	2.99	2.99	2.98	3.00	3.31	3.31	3.30	3.32	3.69	3.69	3.68	3.70
		Amps	7.7	7.7	7.6	7.7	8.8	8.7	8.7	8.8	10.0	10.0	9.9	10.0	11.3	11.3	11.3	11.3	12.8	12.8	12.7	12.8	14.5	14.5	14.5	14.5
	1350	MBh	37.1	37.6	38.7	40.3	36.8	37.3	38.3	39.9	35.9	36.4	37.4	39.0	34.3	34.8	35.8	37.4	32.4	32.9	33.9	35.5	30.6	31.1	32.1	33.8
		S/T	1.00	0.98	0.85	0.7	1.00	1.00	0.85	0.7	1.00	1.00	0.88	0.7	1.00	1.00	0.90	0.8	1.00	1.00	1.00	0.8	1.00	1.00	1.00	0.8
		ΔT	30	28	25	21	30	28	25	21	31	29	25	21	30	28	25	21	30	28	25	21	31	29	26	22
		kW	2.21	2.21	2.20	2.2	2.45	2.45	2.44	2.5	2.71	2.71	2.71	2.7	3.00	3.00	3.00	3.0	3.32	3.32	3.32	3.3	3.70	3.70	3.69	3.7
		Amps	7.7	7.7	7.7	7.8	8.8	8.8	8.8	8.9	10.0	10.0	10.0	10.1	11.3	11.3	11.3	11.4	12.8	12.8	12.8	12.9	14.5	14.5	14.5	14.6

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

Shaded area reflects AHRI conditions

DB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

		OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
IDB	AIRFLOW	ENTERING INDOOR WET BULB TEMPERATURE																																			
70		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
	MBh	40.7	41.3	42.5	-	40.3	40.9	42.1	-	39.3	39.8	41.1	-	37.4	38.0	39.2	-	35.2	35.8	37.0	-	33.2	33.7	35.0	-	33.2	33.7	35.0	-								
	S/T	0.61	0.53	0.40	-	0.61	0.54	0.40	-	0.64	0.56	0.43	-	1.00	0.58	0.45	-	1.00	0.60	0.47	-	1.00	0.66	0.52	-	1.00	0.66	0.52	-								
	ΔT	21	19	15	-	21	19	15	-	21	19	15	-	20	19	15	-	20	18	15	-	21	20	16	-	21	20	16	-								
	kW	2.53	2.53	2.52	-	2.80	2.80	2.79	-	3.11	3.10	3.10	-	3.44	3.43	3.43	-	3.81	3.80	3.80	-	4.24	4.24	4.23	-	4.24	4.24	4.23	-								
	Amps	8.7	8.7	8.7	-	10.0	10.0	10.0	-	11.4	11.4	11.4	-	12.9	12.9	12.9	-	14.6	14.6	14.6	-	16.6	16.6	16.5	-	16.6	16.6	16.5	-								
1400		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
	MBh	41.2	41.8	43.0	-	40.9	41.4	42.7	-	39.8	40.4	41.6	-	38.0	38.5	39.8	-	35.7	36.3	37.5	-	33.7	34.3	35.5	-	33.7	34.3	35.5	-								
	S/T	0.67	0.59	0.46	-	0.67	0.60	0.46	-	0.70	0.62	0.49	-	1.00	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.72	0.58	-	1.00	0.72	0.58	-								
	ΔT	19	18	14	-	19	17	14	-	20	18	14	-	19	17	14	-	19	17	14	-	20	18	15	-	20	18	15	-								
	kW	2.54	2.54	2.54	-	2.82	2.81	2.81	-	3.12	3.12	3.11	-	3.45	3.45	3.44	-	3.82	3.82	3.81	-	4.25	4.25	4.24	-	4.25	4.25	4.24	-								
	Amps	8.8	8.8	8.8	-	10.1	10.1	10.0	-	11.5	11.4	11.4	-	13.0	13.0	12.9	-	14.7	14.6	14.6	-	16.6	16.6	16.6	-	16.6	16.6	16.6	-								
1575		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
	MBh	41.9	42.4	43.7	-	41.5	42.1	43.3	-	40.4	41.0	42.2	-	38.6	39.2	40.4	-	36.4	37.0	38.2	-	34.3	34.9	36.1	-	34.3	34.9	36.1	-								
	S/T	0.70	0.63	0.49	-	0.71	0.63	0.50	-	0.73	0.66	0.52	-	1.00	0.68	0.54	-	1.00	0.70	0.56	-	1.00	0.75	0.61	-	1.00	0.75	0.61	-								
	ΔT	18	17	13	-	18	16	13	-	19	17	13	-	18	16	13	-	18	16	13	-	19	17	14	-	19	17	14	-								
	kW	2.55	2.55	2.55	-	2.83	2.83	2.82	-	3.13	3.13	3.13	-	3.46	3.46	3.46	-	3.83	3.83	3.82	-	4.26	4.26	4.26	-	4.26	4.26	4.26	-								
	Amps	8.9	8.9	8.8	-	10.1	10.1	10.1	-	11.5	11.5	11.5	-	13.0	13.0	13.0	-	14.7	14.7	14.7	-	16.7	16.7	16.7	-	16.7	16.7	16.7	-								

75	1225	MBh	40.7	41.3	42.5	44.4	40.4	40.9	42.1	44.0	39.3	39.9	41.1	42.9	37.5	38.0	39.3	41.1	35.2	35.8	37.0	38.9	33.2	33.8	35.0	36.8
		S/T	0.74	0.66	0.52	0.4	0.74	0.67	0.53	0.4	1.00	0.69	0.56	0.4	1.00	0.71	0.58	0.4	1.00	0.73	0.60	0.5	1.00	1.00	0.65	0.5
		ΔT	25	23	19	16	25	23	19	16	25	23	20	16	25	23	19	16	24	23	19	15	26	24	20	16
		kW	2.53	2.52	2.52	2.5	2.80	2.80	2.79	2.8	3.10	3.10	3.10	3.1	3.43	3.43	3.43	3.4	3.80	3.80	3.80	3.8	4.24	4.23	4.23	4.2
		Amps	8.7	8.7	8.7	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.4	12.9	12.9	12.9	13.0	14.6	14.6	14.6	14.6	16.6	16.6	16.5	16.6
75	1400	MBh	41.3	41.8	43.0	44.9	40.9	41.5	42.7	44.5	39.8	40.4	41.6	43.5	38.0	38.6	39.8	41.6	35.8	36.3	37.6	39.4	33.7	34.3	35.5	37.4
		S/T	0.80	0.72	0.58	0.4	1.00	0.73	0.59	0.4	1.00	0.75	0.62	0.5	1.00	0.77	0.64	0.5	1.00	0.79	0.66	0.5	1.00	1.00	0.71	0.6
		ΔT	24	22	18	14	24	22	18	14	24	22	18	15	24	22	18	14	23	21	18	14	24	23	19	15
		kW	2.54	2.54	2.53	2.55	2.81	2.81	2.81	2.83	3.12	3.12	3.11	3.13	3.45	3.45	3.44	3.46	3.82	3.82	3.81	3.83	4.25	4.25	4.24	4.26
		Amps	8.8	8.8	8.8	8.9	10.1	10.0	10.0	10.1	11.5	11.4	11.4	11.5	13.0	13.0	12.9	13.0	14.6	14.6	14.6	14.7	16.6	16.6	16.6	16.7
75	1575	MBh	41.9	42.5	43.7	45.5	41.5	42.1	43.3	45.2	40.5	41.0	42.3	44.1	38.6	39.2	40.4	42.3	36.4	37.0	38.2	40.1	34.4	34.9	36.2	38.0
		S/T	0.83	0.75	0.62	0.5	1.00	0.76	0.62	0.5	1.00	0.79	0.65	0.5	1.00	0.81	0.67	0.5	1.00	1.00	0.69	0.5	1.00	1.00	0.74	0.6
		ΔT	23	21	17	13	23	21	17	13	23	21	17	14	23	21	17	13	22	20	17	13	23	22	18	14
		kW	2.55	2.55	2.55	2.6	2.83	2.82	2.82	2.8	3.13	3.13	3.12	3.1	3.46	3.46	3.45	3.5	3.83	3.83	3.82	3.8	4.26	4.26	4.26	4.3
		Amps	8.9	8.8	8.8	8.9	10.1	10.1	10.1	10.2	11.5	11.5	11.5	11.6	13.0	13.0	13.0	13.1	14.7	14.7	14.7	14.8	16.7	16.7	16.7	16.7

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
		ENTERING INDOOR WET BULB TEMPERATURE																																			
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
80	1225	MBh	40.9	41.5	42.7	44.6	40.6	41.1	42.4	44.2	39.5	40.1	41.3	43.2	37.7	38.2	39.5	41.3	35.4	36.0	37.2	39.1	33.4	34.0	35.2	37.0											
		S/T	1.00	0.79	0.65	0.5	1.00	0.79	0.66	0.5	1.00	0.82	0.68	0.5	1.00	1.00	0.70	0.6	1.00	1.00	0.72	0.6	1.00	1.00	0.77	0.6											
		ΔT	29	27	23	20	29	27	23	20	29	27	24	20	29	27	23	20	29	27	23	19	30	28	24	21											
		kW	2.53	2.53	2.52	2.5	2.80	2.80	2.79	2.8	3.11	3.10	3.10	3.1	3.44	3.43	3.43	3.5	3.80	3.80	3.80	3.8	4.24	4.24	4.23	4.3											
		Amps	8.7	8.7	8.7	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.5	12.9	12.9	12.9	13.0	14.6	14.6	14.6	14.7	16.6	16.6	16.6	16.5	16.6										
80	1400	MBh	41.5	42.0	43.3	45.1	41.1	41.7	42.9	44.7	40.0	40.6	41.8	43.7	38.2	38.8	40.0	41.9	36.0	36.5	37.8	39.6	33.9	34.5	35.7	37.6											
		S/T	1.00	0.85	0.71	0.6	1.00	0.85	0.72	0.6	1.00	0.88	0.74	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.6	1.00	1.00	0.83	0.7											
		ΔT	28	26	22	19	28	26	22	19	28	26	23	19	28	26	22	19	27	26	22	18	29	27	23	20											
		kW	2.54	2.54	2.54	2.56	2.82	2.81	2.81	2.83	3.12	3.12	3.11	3.13	3.45	3.45	3.44	3.46	3.82	3.82	3.81	3.83	4.25	4.25	4.24	4.27											
		Amps	8.8	8.8	8.8	8.9	10.1	10.1	10.0	10.1	11.5	11.4	11.4	11.5	13.0	13.0	13.0	12.9	14.7	14.7	14.6	14.7	16.6	16.6	16.6	16.6	16.7										
1575		MBh	42.1	42.7	43.9	45.8	41.7	42.3	43.5	45.4	40.7	41.3	42.5	44.3	38.9	39.4	40.6	42.5	36.6	37.2	38.4	40.3	34.6	35.2	36.4	38.2											
		S/T	1.00	0.88	0.74	0.6	1.00	0.89	0.75	0.6	1.00	0.91	0.78	0.6	1.00	1.00	0.80	0.7	1.00	1.00	0.82	0.7	1.00	1.00	0.87	0.7											
		ΔT	27	25	21	18	27	25	21	18	27	25	22	18	27	25	21	18	27	25	21	17	28	26	22	19											
		kW	2.55	2.55	2.55	2.6	2.83	2.83	2.82	2.8	3.13	3.13	3.13	3.1	3.46	3.46	3.46	3.5	3.83	3.83	3.82	3.8	4.26	4.26	4.26	4.3											
		Amps	8.9	8.9	8.8	8.9	10.1	10.1	10.1	10.2	11.5	11.5	11.5	11.6	13.0	13.0	13.0	13.1	14.7	14.7	14.7	14.8	16.7	16.7	16.7	16.7	16.8										

85	1225	MBh	41.6	42.2	43.4	45.3	41.3	41.8	43.0	44.9	40.2	40.8	42.0	43.8	38.4	38.9	40.2	42.0	36.1	36.7	37.9	39.8	34.1	34.7	35.9	37.7
		S/T	1.00	0.89	0.75	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.6	1.00	1.00	0.80	0.7	1.00	1.00	0.82	0.7	1.00	1.00	1.00	0.7
		ΔT	33	31	27	24	33	31	27	23	33	31	27	24	33	31	27	23	32	30	27	23	34	32	28	24
		kW	2.53	2.53	2.53	2.5	2.81	2.80	2.80	2.8	3.11	3.11	3.10	3.1	3.44	3.44	3.43	3.5	3.81	3.81	3.80	3.8	4.24	4.24	4.24	4.3
		Amps	8.8	8.8	8.7	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.5	12.9	12.9	12.9	13.0	14.6	14.6	14.6	14.7	16.6	16.6	16.6	16.7
85	1400	MBh	42.2	42.7	43.9	45.8	41.8	42.4	43.6	45.4	40.7	41.3	42.5	44.4	38.9	39.5	40.7	42.5	36.7	37.2	38.5	40.3	34.6	35.2	36.4	38.3
		S/T	1.00	0.95	0.81	0.7	1.00	1.00	0.82	0.7	1.00	1.00	0.84	0.7	1.00	1.00	0.86	0.7	1.00	1.00	1.00	0.7	1.00	1.00	1.00	0.8
		ΔT	32	30	26	22	31	30	26	22	32	30	26	23	31	30	26	22	31	29	26	22	32	30	27	23
		kW	2.55	2.55	2.54	2.56	2.82	2.82	2.81	2.83	3.13	3.12	3.12	3.14	3.46	3.45	3.45	3.47	3.82	3.82	3.82	3.84	4.26	4.25	4.25	4.27
		Amps	8.8	8.8	8.8	8.9	10.1	10.1	10.1	10.1	11.5	11.5	11.4	11.5	13.0	13.0	13.0	13.1	14.7	14.7	14.6	14.7	16.7	16.6	16.6	16.7
1575	1575	MBh	42.8	43.4	44.6	46.4	42.4	43.0	44.2	46.1	41.4	41.9	43.2	45.0	39.5	40.1	41.3	43.2	37.3	37.9	39.1	41.0	35.3	35.8	37.1	38.9
		S/T	1.00	0.98	0.85	0.7	1.00	1.00	0.85	0.7	1.00	1.00	0.88	0.7	1.00	1.00	0.90	0.8	1.00	1.00	1.00	0.8	1.00	1.00	1.00	0.8
		ΔT	31	29	25	21	31	29	25	21	31	29	25	22	30	29	25	21	30	28	25	21	31	30	26	22
		kW	2.56	2.56	2.55	2.6	2.83	2.83	2.83	2.8	3.14	3.14	3.13	3.2	3.47	3.47	3.46	3.5	3.84	3.83	3.83	3.9	4.27	4.27	4.26	4.3
		Amps	8.9	8.9	8.9	9.0	10.1	10.1	10.1	10.2	11.5	11.5	11.5	11.6	13.0	13.0	13.0	13.1	14.7	14.7	14.7	14.8	16.7	16.7	16.7	16.8

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

Shaded area reflects AHRI conditions

DB: Entering Indoor Dry Bulb Temperature

		OUTDOOR AMBIENT TEMPERATURE																								
		65								75								85								
		105								115																
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1450	MBh	46.9	47.6	48.9	-	46.5	47.1	48.5	-	45.3	45.9	47.3	-	43.2	43.9	45.2	-	40.7	41.3	42.7	-	38.3	39.0	40.4	-
		S/T	0.63	0.56	0.43	-	0.63	0.56	0.43	-	0.66	0.59	0.46	-	0.68	0.60	0.48	-	1.00	0.62	0.50	-	1.00	0.67	0.55	-
		ΔT	19	17	14	-	19	17	14	-	19	17	14	-	19	17	14	-	19	17	13	-	20	18	15	-
		kW	2.86	2.86	2.85	-	3.18	3.18	3.17	-	3.54	3.54	3.53	-	3.93	3.92	3.92	-	4.36	4.36	4.35	-	4.87	4.86	4.86	-
		Amps	10.2	10.2	10.1	-	11.6	11.6	11.6	-	13.3	13.3	13.2	-	15.0	15.0	15.0	-	17.0	17.0	17.0	-	19.3	19.3	19.3	-
	1600	MBh	47.5	48.1	49.5	-	47.1	47.7	49.1	-	45.9	46.5	47.9	-	43.8	44.4	45.8	-	41.2	41.9	43.3	-	38.9	39.6	41.0	-
		S/T	0.66	0.58	0.46	-	0.66	0.59	0.46	-	0.69	0.61	0.49	-	0.70	0.63	0.50	-	1.00	0.65	0.53	-	1.00	0.70	0.57	-
		ΔT	18	16	13	-	18	16	13	-	18	17	13	-	18	16	13	-	18	16	13	-	19	17	14	-
		kW	2.87	2.87	2.87	-	3.19	3.19	3.19	-	3.55	3.55	3.54	-	3.94	3.94	3.93	-	4.37	4.37	4.36	-	4.88	4.87	4.87	-
		Amps	10.2	10.2	10.2	-	11.7	11.7	11.7	-	13.3	13.3	13.3	-	15.1	15.1	15.1	-	17.1	17.1	17.0	-	19.4	19.4	19.4	-
	1800	MBh	48.4	49.1	50.5	-	48.0	48.7	50.1	-	46.8	47.5	48.9	-	44.7	45.4	46.8	-	42.2	42.9	44.2	-	39.9	40.5	41.9	-
		S/T	0.67	0.60	0.47	-	0.68	0.60	0.48	-	0.70	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.67	0.54	-	1.00	0.72	0.59	-
		ΔT	17	15	12	-	17	15	12	-	18	16	12	-	17	15	12	-	17	15	12	-	18	16	13	-
		kW	2.89	2.88	2.88	-	3.21	3.20	3.20	-	3.56	3.56	3.56	-	3.95	3.95	3.94	-	4.38	4.38	4.38	-	4.89	4.89	4.88	-
		Amps	10.3	10.3	10.3	-	11.8	11.7	11.7	-	13.4	13.4	13.4	-	15.2	15.1	15.1	-	17.1	17.1	17.1	-	19.5	19.4	19.4	-
75	1450	MBh	46.9	47.6	49.0	51.1	46.5	47.2	48.5	50.7	45.3	46.0	47.3	49.5	43.2	43.9	45.3	47.4	40.7	41.3	42.7	44.8	38.4	39.0	40.4	42.5
		S/T	0.75	0.68	0.55	0.4	0.76	0.68	0.56	0.4	1.00	0.71	0.58	0.4	1.00	0.73	0.60	0.5	1.00	0.75	0.62	0.5	1.00	0.80	0.67	0.5
		ΔT	23	21	18	14	23	21	18	14	23	22	18	14	23	21	18	14	23	21	17	14	24	22	19	15
		kW	2.86	2.86	2.85	2.9	3.18	3.18	3.17	3.2	3.54	3.53	3.53	3.6	3.92	3.92	3.92	3.9	4.36	4.35	4.35	4.4	4.86	4.86	4.86	4.9
		Amps	10.2	10.2	10.1	10.2	11.6	11.6	11.6	11.7	13.3	13.3	13.2	13.3	15.0	15.0	15.0	15.1	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4
	1600	MBh	47.5	48.2	49.6	51.7	47.1	47.8	49.1	51.3	45.9	46.6	47.9	50.0	43.8	44.5	45.9	48.0	41.3	41.9	43.3	45.4	39.0	39.6	41.0	43.1
		S/T	0.78	0.71	0.58	0.4	0.78	0.71	0.58	0.4	1.00	0.74	0.61	0.5	1.00	0.75	0.63	0.5	1.00	0.77	0.65	0.5	1.00	1.00	0.70	0.6
		ΔT	22	21	17	13	22	20	17	13	23	21	17	14	22	20	17	13	22	20	17	13	23	21	18	14
		kW	2.87	2.87	2.86	2.89	3.19	3.19	3.18	3.21	3.55	3.55	3.54	3.57	3.94	3.93	3.93	3.95	4.37	4.37	4.36	4.38	4.88	4.87	4.87	4.89
		Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.6	11.8	13.3	13.3	13.3	13.4	15.1	15.1	15.1	15.2	17.1	17.1	17.0	17.1	19.4	19.4	19.4	19.5
	1800	MBh	48.5	49.1	50.5	52.6	48.1	48.7	50.1	52.2	46.8	47.5	48.9	51.0	44.8	45.4	46.8	48.9	42.2	42.9	44.3	46.4	39.9	40.6	41.9	44.1
		S/T	0.79	0.72	0.59	0.5	0.80	0.73	0.60	0.5	1.00	0.75	0.62	0.5	1.00	0.77	0.64	0.5	1.00	0.79	0.66	0.5	1.00	1.00	0.71	0.6
		ΔT	21	20	16	12	21	20	16	12	22	20	16	13	21	19	16	12	21	19	16	12	22	20	17	13
		kW	2.88	2.88	2.88	2.9	3.21	3.20	3.20	3.2	3.56	3.56	3.55	3.6	3.95	3.95	3.94	4.0	4.38	4.38	4.37	4.4	4.89	4.89	4.88	4.9
		Amps	10.3	10.3	10.2	10.4	11.7	11.7	11.7	11.8	13.4	13.4	13.3	13.5	15.2	15.1	15.1	15.2	17.1	17.1	17.1	17.2	19.5	19.4	19.4	19.5

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions
kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																115								
		65								75								105								
		85								95								105								
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	1450	MBh	47.2	47.8	49.2	51.3	46.8	47.4	48.8	50.9	45.5	46.2	47.6	49.7	43.5	44.1	45.5	47.6	40.9	41.6	43.0	45.1	38.6	39.3	40.6	42.8
		S/T	0.87	0.80	0.67	0.5	1.00	0.80	0.67	0.5	1.00	0.83	0.70	0.6	1.00	0.84	0.72	0.6	1.00	1.00	0.74	0.6	1.00	1.00	0.79	0.7
		ΔT	27	25	22	18	27	25	22	18	28	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19
		kW	2.86	2.86	2.85	2.9	3.18	3.18	3.17	3.2	3.54	3.54	3.53	3.6	3.93	3.92	3.92	3.9	4.36	4.36	4.35	4.4	4.87	4.86	4.86	4.9
		Amps	10.2	10.2	10.1	10.2	11.6	11.6	11.6	11.7	13.3	13.3	13.2	13.3	15.0	15.0	15.0	15.1	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4
	1600	MBh	47.8	48.4	49.8	51.9	47.3	48.0	49.4	51.5	46.1	46.8	48.2	50.3	44.1	44.7	46.1	48.2	41.5	42.2	43.6	45.7	39.2	39.8	41.2	43.3
		S/T	1.00	0.82	0.70	0.6	1.00	0.83	0.70	0.6	1.00	0.85	0.73	0.6	1.00	0.87	0.74	0.6	1.00	1.00	0.77	0.6	1.00	1.00	0.81	0.7
		ΔT	27	25	21	18	26	25	21	17	27	25	21	18	26	25	21	17	26	24	21	17	27	25	22	18
		kW	2.87	2.87	2.86	2.89	3.19	3.19	3.19	3.21	3.55	3.55	3.54	3.57	3.94	3.93	3.93	3.95	4.37	4.37	4.36	4.39	4.88	4.87	4.87	4.89
		Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.7	11.8	13.3	13.3	13.3	13.4	15.1	15.1	15.1	15.2	17.1	17.1	17.0	17.1	19.4	19.4	19.4	19.5
	1800	MBh	48.7	49.4	50.7	52.9	48.3	48.9	50.3	52.4	47.1	47.7	49.1	51.2	45.0	45.7	47.0	49.2	42.5	43.1	44.5	46.6	40.1	40.8	42.2	44.3
		S/T	1.00	0.84	0.71	0.6	1.00	0.84	0.72	0.6	1.00	0.87	0.74	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.6	1.00	1.00	0.83	0.7
		ΔT	26	24	20	17	26	24	20	17	26	24	20	17	25	24	20	17	25	23	20	16	26	25	21	17
		kW	2.89	2.88	2.88	2.9	3.21	3.20	3.20	3.2	3.56	3.56	3.56	3.6	3.95	3.95	3.94	4.0	4.38	4.38	4.38	4.4	4.89	4.89	4.88	4.9
		Amps	10.3	10.3	10.2	10.4	11.8	11.7	11.7	11.8	13.4	13.4	13.4	13.5	15.2	15.1	15.1	15.2	17.1	17.1	17.1	17.2	19.5	19.4	19.4	19.5
85	1450	MBh	47.9	48.6	50.0	52.1	47.5	48.2	49.6	51.7	46.3	47.0	48.4	50.5	44.2	44.9	46.3	48.4	41.7	42.4	43.7	45.9	39.4	40.0	41.4	43.5
		S/T	1.00	0.89	0.76	0.6	1.00	0.90	0.77	0.6	1.00	1.00	0.79	0.7	1.00	1.00	0.81	0.7	1.00	1.00	0.83	0.7	1.00	1.00	1.00	0.7
		ΔT	31	29	26	22	31	29	26	22	31	29	26	22	31	29	26	22	31	29	25	22	32	30	26	23
		kW	2.87	2.86	2.86	2.9	3.19	3.18	3.18	3.2	3.55	3.54	3.54	3.6	3.93	3.93	3.92	3.9	4.36	4.36	4.36	4.4	4.87	4.87	4.86	4.9
		Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.6	11.7	13.3	13.3	13.3	13.4	15.1	15.1	15.0	15.1	17.0	17.0	17.0	17.1	19.4	19.4	19.3	19.4
	1600	MBh	48.5	49.2	50.6	52.7	48.1	48.8	50.2	52.3	46.9	47.6	49.0	51.1	44.8	45.5	46.9	49.0	42.3	42.9	44.3	46.4	40.0	40.6	42.0	44.1
		S/T	1.00	0.92	0.79	0.7	1.00	0.93	0.80	0.7	1.00	1.00	0.82	0.7	1.00	1.00	0.84	0.7	1.00	1.00	0.86	0.7	1.00	1.00	1.00	0.8
		ΔT	30	28	25	21	30	28	25	21	30	29	25	21	30	28	25	21	30	28	25	21	31	29	26	22
		kW	2.88	2.88	2.87	2.90	3.20	3.20	3.19	3.22	3.56	3.55	3.55	3.57	3.94	3.94	3.94	3.96	4.38	4.37	4.37	4.39	4.88	4.88	4.88	4.90
		Amps	10.3	10.2	10.2	10.3	11.7	11.7	11.7	11.8	13.4	13.3	13.3	13.4	15.1	15.1	15.1	15.2	17.1	17.1	17.1	17.2	19.4	19.4	19.4	19.5
	1800	MBh	49.5	50.1	51.5	53.6	49.1	49.7	51.1	53.2	47.9	48.5	49.9	52.0	45.8	46.4	47.8	49.9	43.2	43.9	45.3	47.4	40.9	41.6	43.0	45.1
		S/T	1.00	0.93	0.81	0.7	1.00	1.00	0.81	0.7	1.00	1.00	0.84	0.7	1.00	1.00	0.85	0.7	1.00	1.00	0.88	0.7	1.00	1.00	1.00	0.8
		ΔT	29	27	24	20	29	27	24	20	29	28	24	20	29	27	24	20	29	27	24	20	30	28	25	21
		kW	2.89	2.89	2.88	2.9	3.21	3.21	3.20	3.2	3.57	3.57	3.56	3.6	3.96	3.95	3.95	4.0	4.39	4.39	4.38	4.4	4.90	4.89	4.89	4.9
		Amps	10.3	10.3	10.3	10.4	11.8	11.8	11.7	11.9	13.4	13.4	13.4	13.5	15.2	15.2	15.2	15.3	17.2	17.2	17.1	17.2	19.5	19.5	19.4	19.6

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																																															
		65								75								85								95								105								115							
IDB	AIRFLOW	ENTERING INDOOR WET BULB TEMPERATURE																																															
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71																				
1485	MBh	58.8	59.6	61.3	-	58.2	59.1	60.8	-	56.7	57.5	59.3	-	54.1	54.9	56.7	-	50.9	51.7	53.5	-	48.0	48.8	50.6	-																								
	S/T	0.59	0.52	0.40	-	0.59	0.53	0.41	-	0.62	0.55	0.43	-	0.63	0.57	0.45	-	0.65	0.59	0.47	-	1.00	0.63	0.51	-																								
	ΔT	22	20	16	-	22	20	16	-	23	20	16	-	22	20	16	-	22	20	16	-	23	21	17	-																								
	kW	3.52	3.52	3.51	-	3.94	3.94	3.93	-	4.41	4.41	4.40	-	4.92	4.92	4.91	-	5.49	5.48	5.48	-	6.15	6.15	6.14	-																								
	Amps	13.1	13.1	13.1	-	15.0	15.0	15.0	-	17.2	17.2	17.1	-	19.5	19.5	19.4	-	22.1	22.1	22.0	-	25.1	25.1	25.1	-																								
2000	MBh	61.8	62.6	64.3	-	61.2	62.1	63.8	-	59.7	60.5	62.3	-	57.1	57.9	59.7	-	53.9	54.8	56.5	-	51.0	51.9	53.6	-																								
	S/T	0.62	0.56	0.44	-	0.63	0.56	0.44	-	0.65	0.58	0.46	-	0.67	0.60	0.48	-	1.00	0.62	0.50	-	1.00	0.67	0.55	-																								
	ΔT	20	17	13	-	19	17	13	-	20	18	14	-	19	17	13	-	19	17	13	-	21	18	14	-																								
	kW	3.57	3.57	3.56	-	3.99	3.99	3.98	-	4.46	4.46	4.45	-	4.97	4.96	4.96	-	5.53	5.53	5.52	-	6.20	6.19	6.19	-																								
	Amps	13.3	13.3	13.3	-	15.2	15.2	15.2	-	17.4	17.4	17.3	-	19.7	19.7	19.7	-	22.3	22.3	22.3	-	25.3	25.3	25.3	-																								
2250	MBh	63.8	64.7	66.4	-	63.3	64.1	65.9	-	61.8	62.6	64.4	-	59.2	60.0	61.7	-	56.0	56.8	58.6	-	53.1	53.9	55.7	-																								
	S/T	0.59	0.52	0.40	-	0.60	0.53	0.41	-	0.62	0.55	0.43	-	1.00	0.57	0.45	-	1.00	0.59	0.47	-	1.00	0.63	0.51	-																								
	ΔT	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	18	16	12	-	19	17	13	-																								
	kW	3.59	3.59	3.58	-	4.01	4.01	4.00	-	4.48	4.48	4.47	-	4.99	4.98	4.98	-	5.55	5.55	5.54	-	6.22	6.21	6.21	-																								
	Amps	13.4	13.4	13.4	-	15.3	15.3	15.3	-	17.5	17.5	17.4	-	19.8	19.8	19.7	-	22.4	22.4	22.3	-	25.4	25.4	25.4	-																								

75	1485	MBh	58.8	59.6	61.3	64.0	58.3	59.1	60.8	63.5	56.8	57.6	59.3	62.0	54.1	55.0	56.7	59.3	51.0	51.8	53.5	56.2	48.1	48.9	50.6	53.3
		S/T	0.70	0.64	0.52	0.4	0.71	0.64	0.52	0.4	0.73	0.66	0.54	0.4	1.00	0.68	0.56	0.4	1.00	0.70	0.58	0.5	1.00	0.75	0.63	0.5
		ΔT	27	25	21	17	27	25	21	17	27	25	21	17	27	25	21	17	27	25	21	16	28	26	22	18
		kW	3.52	3.52	3.51	3.5	3.94	3.94	3.93	4.0	4.41	4.41	4.40	4.4	4.92	4.91	4.91	4.9	5.48	5.48	5.47	5.5	6.15	6.15	6.14	6.2
		Amps	13.1	13.1	13.0	13.2	15.0	15.0	15.0	15.1	17.2	17.1	17.1	17.3	19.5	19.5	19.4	19.6	22.1	22.1	22.0	22.2	25.1	25.1	25.1	25.2
	2000	MBh	61.8	62.6	64.3	67.0	61.3	62.1	63.8	66.5	59.8	60.6	62.3	65.0	57.2	58.0	59.7	62.4	54.0	54.8	56.5	59.2	51.1	51.9	53.6	56.3
		S/T	0.74	0.67	0.55	0.4	0.74	0.68	0.56	0.4	1.00	0.70	0.58	0.5	1.00	0.72	0.60	0.5	1.00	0.74	0.62	0.5	1.00	0.78	0.66	0.5
		ΔT	24	22	18	14	24	22	18	14	25	22	18	14	24	22	18	14	24	22	18	13	25	23	19	15
		kW	3.57	3.56	3.56	3.59	3.99	3.98	3.98	4.01	4.46	4.45	4.45	4.48	4.96	4.96	4.95	4.99	5.53	5.53	5.52	5.55	6.20	6.19	6.19	6.22
		Amps	13.3	13.3	13.3	13.4	15.2	15.2	15.2	15.3	17.4	17.4	17.3	17.5	19.7	19.7	19.6	19.8	22.3	22.3	22.2	22.4	25.3	25.3	25.3	25.4
	2250	MBh	63.9	64.7	66.4	69.1	63.3	64.2	65.9	68.5	61.8	62.7	64.4	67.0	59.2	60.0	61.8	64.4	56.0	56.9	58.6	61.2	53.1	54.0	55.7	58.3
		S/T	0.70	0.64	0.52	0.4	0.71	0.64	0.52	0.4	1.00	0.66	0.54	0.4	1.00	0.68	0.56	0.4	1.00	0.70	0.58	0.5	1.00	1.00	0.63	0.5
		ΔT	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	12	24	22	18	14
		kW	3.59	3.58	3.58	3.6	4.01	4.00	4.00	4.0	4.48	4.47	4.47	4.5	4.98	4.98	4.97	5.0	5.55	5.55	5.54	5.6	6.21	6.21	6.20	6.2
		Amps	13.4	13.4	13.3	13.5	15.3	15.3	15.3	15.4	17.5	17.4	17.4	17.6	19.8	19.8	19.7	19.9	22.4	22.4	22.3	22.5	25.4	25.4	25.4	25.5

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

			OUTDOOR AMBIENT TEMPERATURE																																			
			65						75						85						95						105						115					
			ENTERING INDOOR WET BULB TEMPERATURE																																			
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71									
80	1485	MBh	59.1	59.9	61.6	64.3	58.6	59.4	61.1	63.8	57.1	57.9	59.6	62.3	54.4	55.3	57.0	59.6	51.3	52.1	53.8	56.5	48.4	49.2	50.9	53.6												
		S/T	0.81	0.75	0.63	0.5	1.00	0.75	0.63	0.5	1.00	0.77	0.65	0.5	1.00	0.79	0.67	0.5	1.00	0.81	0.69	0.6	1.00	1.00	0.74	0.6												
		ΔT	32	30	26	21	32	30	26	21	32	30	26	22	32	30	26	21	32	29	25	21	33	31	27	22												
		kW	3.52	3.52	3.51	3.5	3.94	3.94	3.93	4.0	4.41	4.41	4.40	4.4	4.92	4.92	4.91	4.9	5.49	5.48	5.48	5.5	6.15	6.15	6.14	6.2												
		Amps	13.1	13.1	13.1	13.2	15.0	15.0	15.0	15.1	17.2	17.2	17.1	17.3	19.5	19.5	19.4	19.6	22.1	22.1	22.0	22.2	25.1	25.1	25.1	25.2												
80	2000	MBh	62.1	62.9	64.6	67.3	61.6	62.4	64.1	66.8	60.1	60.9	62.6	65.3	57.5	58.3	60.0	62.7	54.3	55.1	56.8	59.5	51.4	52.2	53.9	56.6												
		S/T	0.85	0.78	0.66	0.5	1.00	0.79	0.67	0.5	1.00	0.81	0.69	0.6	1.00	0.83	0.71	0.6	1.00	1.00	0.73	0.6	1.00	1.00	0.77	0.6												
		ΔT	29	27	23	19	29	27	23	19	29	27	23	19	29	27	23	19	29	27	23	18	30	28	24	20												
		kW	3.57	3.57	3.56	3.59	3.99	3.99	3.98	4.01	4.46	4.46	4.45	4.48	4.97	4.96	4.96	4.99	5.53	5.53	5.52	5.55	6.20	6.19	6.19	6.22												
		Amps	13.3	13.3	13.3	13.4	15.2	15.2	15.2	15.3	17.4	17.4	17.3	17.5	19.7	19.7	19.7	19.8	22.3	22.3	22.2	22.4	25.3	25.3	25.3	25.4												
80	2250	MBh	64.2	65.0	66.7	69.4	63.6	64.5	66.2	68.8	62.1	63.0	64.7	67.3	59.5	60.3	62.1	64.7	56.3	57.2	58.9	61.5	53.4	54.3	56.0	58.6												
		S/T	1.00	0.75	0.63	0.5	1.00	0.75	0.63	0.5	1.00	0.78	0.66	0.5	1.00	0.79	0.67	0.5	1.00	1.00	0.69	0.6	1.00	1.00	0.74	0.6												
		ΔT	28	26	22	17	28	26	22	17	28	26	22	18	28	26	22	17	28	25	21	17	29	27	23	18												
		kW	3.59	3.59	3.58	3.6	4.01	4.01	4.00	4.0	4.48	4.47	4.47	4.5	4.99	4.98	4.97	5.0	5.55	5.55	5.54	5.6	6.22	6.21	6.21	6.2												
		Amps	13.4	13.4	13.4	13.5	15.3	15.3	15.3	15.4	17.5	17.5	17.4	17.6	19.8	19.8	19.7	19.9	22.4	22.4	22.3	22.5	25.4	25.4	25.4	25.5												
85	1485	MBh	60.1	60.9	62.6	65.3	59.5	60.4	62.1	64.7	58.0	58.8	60.6	63.2	55.4	56.2	58.0	60.6	52.2	53.1	54.8	57.4	49.3	50.2	51.9	54.5												
		S/T	1.00	0.84	0.72	0.6	1.00	0.84	0.72	0.6	1.00	0.86	0.74	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.7	1.00	1.00	0.83	0.7												
		ΔT	36	34	30	26	36	34	30	26	37	34	30	26	36	34	30	26	36	34	30	25	37	35	31	27												
		kW	3.53	3.53	3.52	3.6	3.95	3.95	3.94	4.0	4.42	4.42	4.41	4.4	4.93	4.92	4.92	4.9	5.49	5.49	5.48	5.5	6.16	6.16	6.15	6.2												
		Amps	13.1	13.1	13.1	13.2	15.1	15.0	15.0	15.2	17.2	17.2	17.2	17.3	19.5	19.5	19.5	19.6	22.1	22.1	22.1	22.2	25.2	25.2	25.2	25.1	25.3											
85	2000	MBh	63.1	63.9	65.6	68.3	62.6	63.4	65.1	67.8	61.0	61.9	63.6	66.2	58.4	59.3	61.0	63.6	55.3	56.1	57.8	60.4	52.3	53.2	54.9	57.5												
		S/T	1.00	0.87	0.75	0.6	1.00	0.88	0.76	0.6	1.00	1.00	0.78	0.7	1.00	1.00	0.80	0.7	1.00	1.00	0.82	0.7	1.00	1.00	0.86	0.7												
		ΔT	33	31	27	23	33	31	27	23	34	32	27	23	33	31	27	23	33	31	27	23	34	32	28	24												
		kW	3.58	3.58	3.57	3.60	4.00	3.99	3.99	4.02	4.47	4.46	4.46	4.49	4.97	4.97	4.96	5.00	5.54	5.54	5.53	5.56	6.21	6.20	6.20	6.23												
		Amps	13.4	13.3	13.3	13.5	15.3	15.3	15.2	15.4	17.4	17.4	17.4	17.5	19.7	19.7	19.7	19.8	22.3	22.3	22.3	22.4	25.4	25.4	25.4	25.3	25.5											
85	2250	MBh	65.1	66.0	67.7	70.3	64.6	65.4	67.2	69.8	63.1	63.9	65.7	68.3	60.5	61.3	63.1	65.7	57.3	58.1	59.9	62.5	54.4	55.2	57.0	59.6												
		S/T	1.00	0.84	0.72	0.6	1.00	1.00	0.72	0.6	1.00	1.00	0.74	0.6	1.00	1.00	0.76	0.6	1.00	1.00	0.78	0.7	1.00	1.00	1.00	0.7												
		ΔT	32	30	26	22	32	30	26	22	33	30	26	22	32	30	26	22	32	30	26	21	33	31	27	23												
		kW	3.60	3.59	3.59	3.6	4.02	4.01	4.01	4.0	4.49	4.48	4.48	4.5	4.99	4.99	4.98	5.0	5.56	5.56	5.55	5.6	6.23	6.22	6.21	6.2												
		Amps	13.4	13.4	13.4	13.5	15.4	15.3	15.3	15.5	17.5	17.5	17.5	17.6	19.8	19.8	19.8	19.9	22.4	22.4	22.4	22.5	25.5	25.4	25.4	25.4	25.6											
			Shaded area reflects AHRI conditions																								kW = Total system power Amps = outdoor unit amps (comp.+fan)											
			IDB: Entering Indoor Dry Bulb Temperature																																			
			High and low pressures are measured at the liquid and suction service valves.																																			

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

DC5SEA1810A*+CAPTA2422*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 525 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	18,870	12,590	6,280	1,230
80	18,635	12,650	5,985	1,300
85	18,400	12,710	5,690	1,370
90	18,000	12,590	5,410	1,445
95	17,600	12,470	5,130	1,520
100	17,110	12,295	4,815	1,600
105	16,620	12,120	4,500	1,680
110	16,170	12,170	4,000	1,775
115	15,720	12,220	3,500	1,870
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	16,970	12,190	4,780	1,520

DC5SEA2410A*+CAPTA2422*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 700 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	25,310	17,050	8,260	1,650
80	24,995	17,130	7,865	1,740
85	24,680	17,210	7,470	1,830
90	24,140	17,050	7,090	1,930
95	23,600	16,890	6,710	2,030
100	22,940	16,650	6,290	2,140
105	22,280	16,410	5,870	2,250
110	21,680	16,480	5,200	2,385
115	21,080	16,550	4,530	2,520
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	22,760	16,510	6,250	2,030

DC5SEA3010A*+CAPTA3026*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 900 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	30,670	21,080	9,590	2,000
80	30,290	21,180	9,110	2,110
85	29,910	21,280	8,630	2,220
90	29,255	21,085	8,170	2,340
95	28,600	20,890	7,710	2,460
100	27,800	20,590	7,210	2,595
105	27,000	20,290	6,710	2,730
110	26,270	20,375	5,895	2,885
115	25,540	20,460	5,080	3,040
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	27,580	20,410	7,170	2,460

DC5SEA3610A*+CAPTA3626*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 1180 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	37,100	26,520	10,580	2,430
80	36,640	26,645	9,995	2,560
85	36,180	26,770	9,410	2,690
90	35,390	26,520	8,870	2,835
95	34,600	26,270	8,330	2,980
100	33,635	25,895	7,740	3,140
105	32,670	25,520	7,150	3,300
110	31,785	25,630	6,155	3,490
115	30,900	25,740	5,160	3,680
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	33,370	25,670	7,700	2,980


DC5SEA4210A*+CAPTA4230*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	42,890	30,740	12,150	2,810
80	42,360	30,885	11,475	2,960
85	41,830	31,030	10,800	3,110
90	40,915	30,740	10,175	3,275
95	40,000	30,450	9,550	3,440
100	38,885	30,020	8,865	3,625
105	37,770	29,590	8,180	3,810
110	36,750	29,710	7,040	4,025
115	35,730	29,830	5,900	4,240
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	38,570	29,760	8,810	3,450


DC5SEA4810A*+CAPTA6030*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 1450 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	48,790	32,900	15,890	3,170
80	48,185	33,055	15,130	3,350
85	47,580	33,210	14,370	3,530
90	46,540	32,900	13,640	3,725
95	45,500	32,590	12,910	3,920
100	44,230	32,125	12,105	4,135
105	42,960	31,660	11,300	4,350
110	41,800	31,795	10,005	4,605
115	40,640	31,930	8,710	4,860
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	43,880	31,850	12,030	3,920

DC5SEA6010A*+CAPTA6030*3A*				
CONDITIONS: 80 °F IBD, 67 °F IWB @ 1485 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATT
75	61,120	38,650	22,470	3,930
80	60,360	38,830	21,530	4,165
85	59,600	39,010	20,590	4,400
90	58,300	38,650	19,650	4,655
95	57,000	38,290	18,710	4,910
100	55,410	37,745	17,665	5,195
105	53,820	37,200	16,620	5,480
110	52,365	37,355	15,010	5,810
115	50,910	37,510	13,400	6,140
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	54,970	37,420	17,550	4,910

***ALL AHRI SYSTEM RATINGS ARE ACCESSIBLE IN THE UNITARY MATCHUP TOOL VIA
DAIKIN CITY OR IN THE DAIKIN SYSTEM CONFIGURATOR TOOL VIA PARTNERLINK.***

MODEL	DIMENSIONS		
	W"	D"	H
DC5SEA1810A*	26	26	27
DC5SEA2410A*	29	29	32
DC5SEA3010A*	35½	35½	39½
DC5SEA3610A*	35½	35½	39½
DC5SEA4210A*	35½	35½	36½
DC5SEA4810A*	35½	35½	36½
DC5SEA6010A*	35½	35½	41½

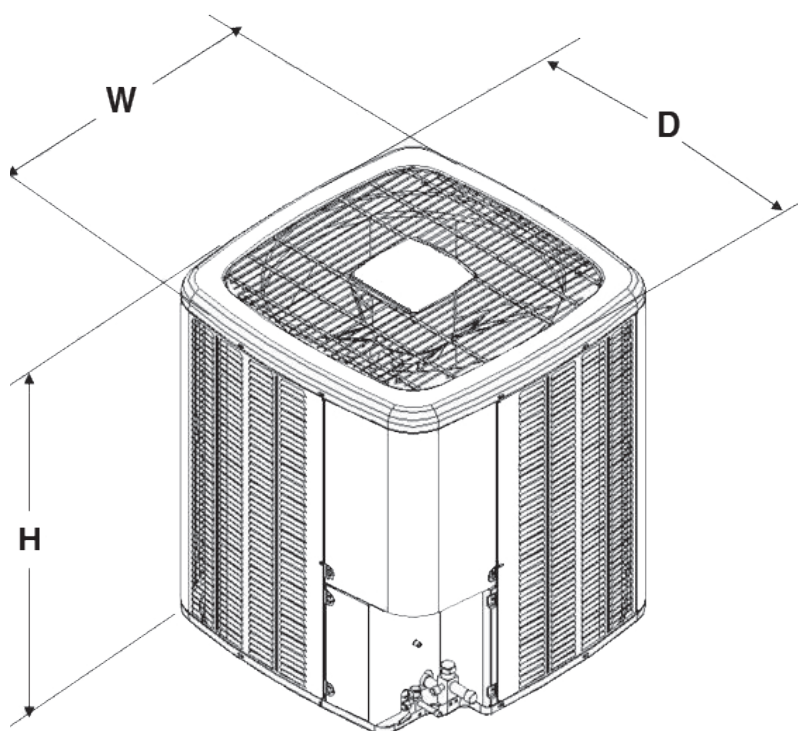


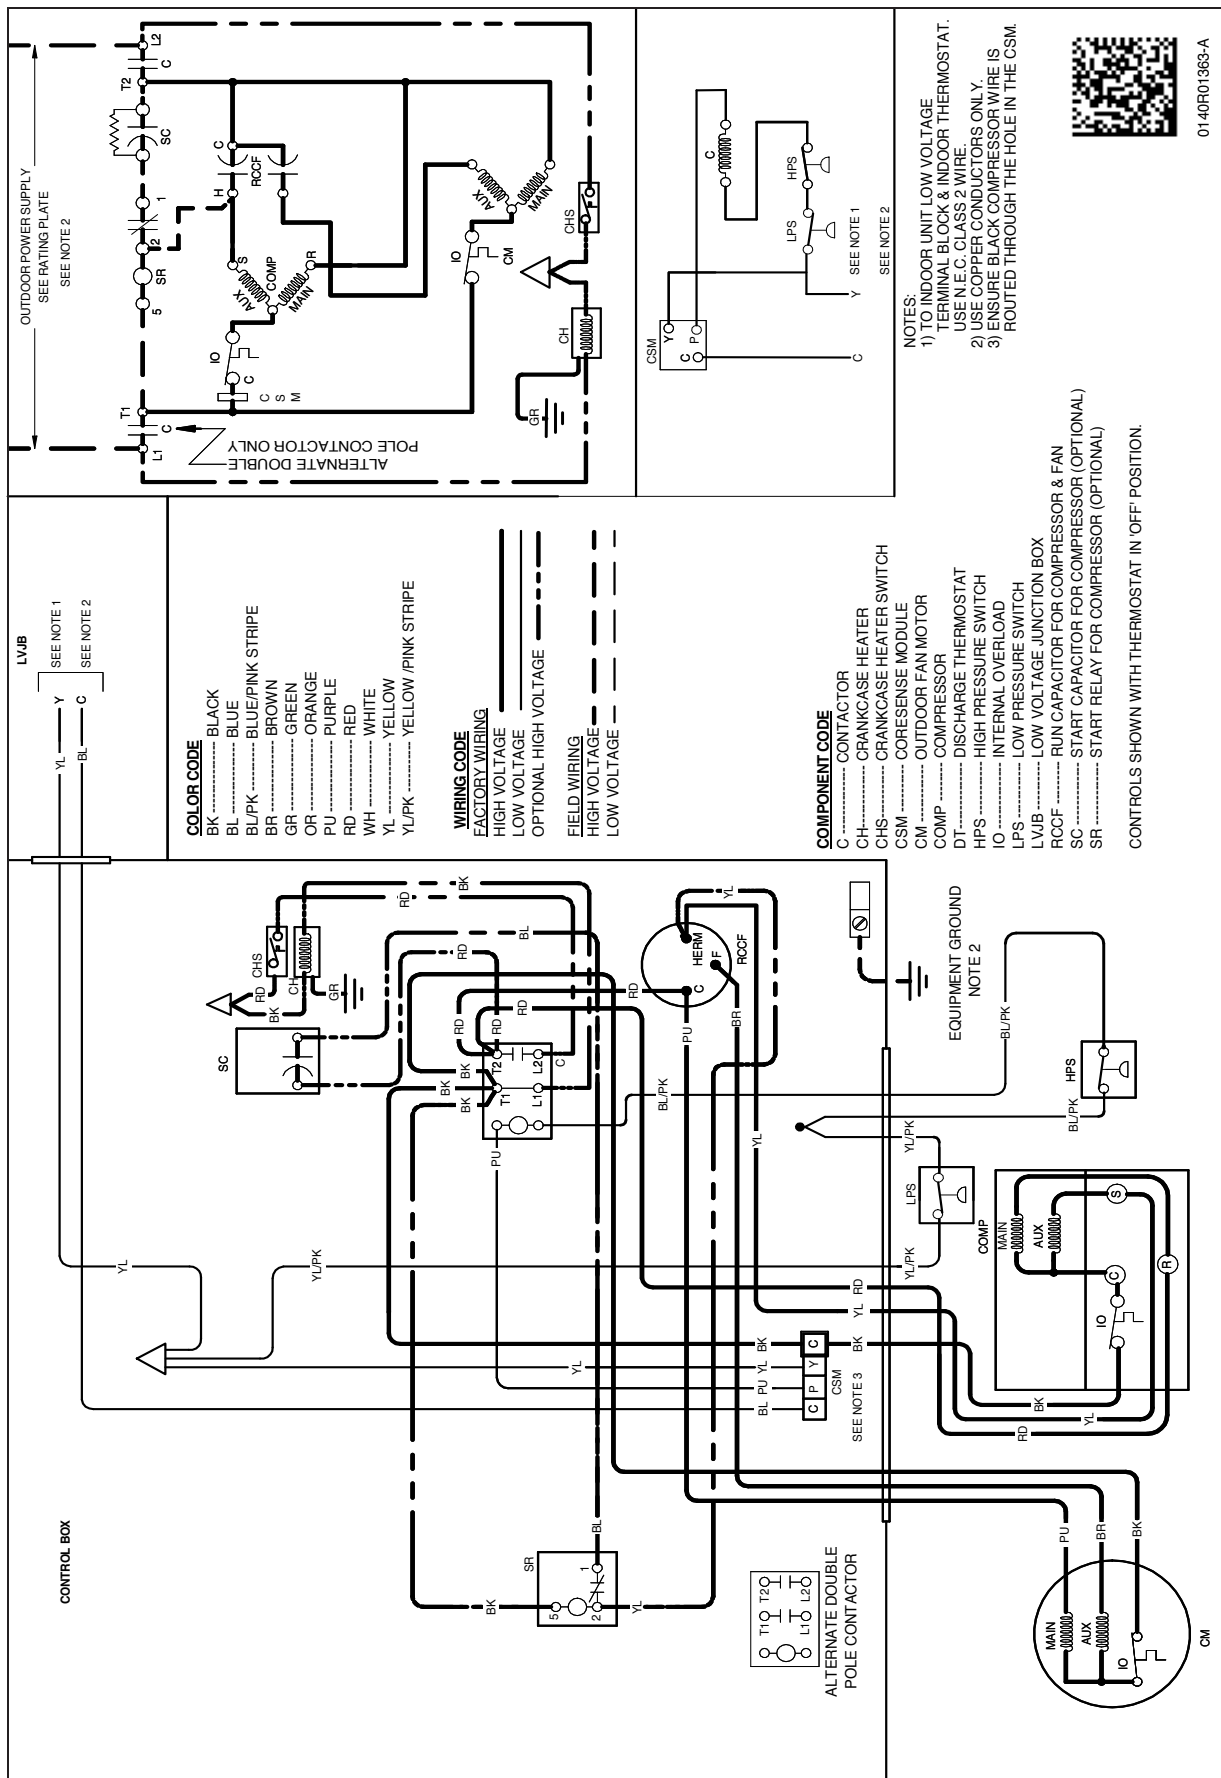

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

⚠ WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

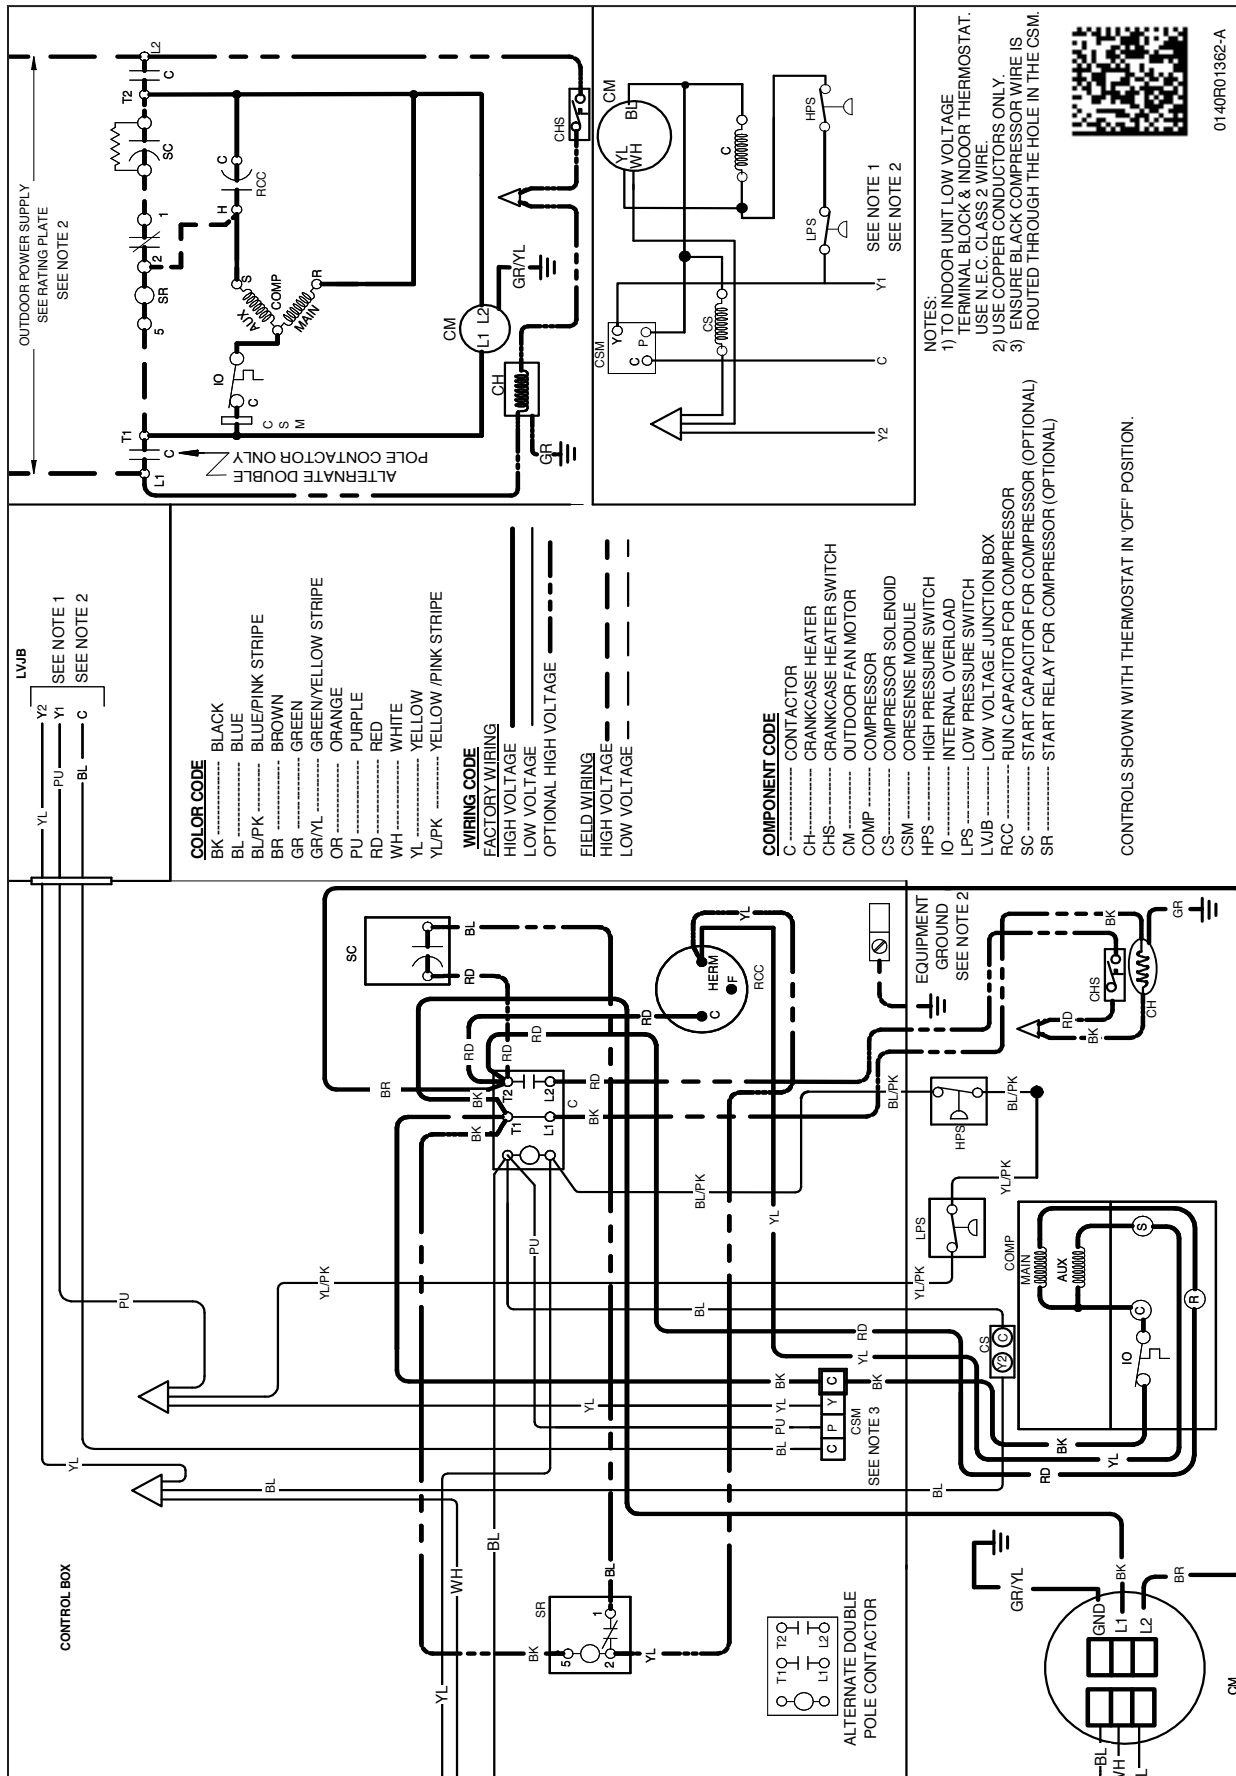

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.



WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



0140R01362-A

MODEL	DESCRIPTION	DC5SEA 1810A*	DC5SEA 2410A*	DC5SEA 3010A*	DC5SEA 3610A*	DC5SEA 4210A*	DC5SEA 4810A*	DC5SEA 6010A*
ABK-20	Anchor Bracket Kit ^	X	X	X	X	X	X	X
ASC01A	Anti-Short Cycle Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X	X	X	X
Factory Installed Crank Case Heater						X	X	X
0163R00006	Crank Case Heater	X	X	X	X			
0130M00106	CCH Temp Switch	X	X	X	X			
FSK01A ¹	Freeze Protection Kit	X	X	X	X	X	X	X
LSK02A ²	Liquid Line Solenoid Kit	X	X	X	X	X	X	X
LAKT01	Low-Ambient Kit	X	X	X	X	X	X	
0130R00000S	Low-Pressure Switch Kit	X	X	X	X	X	X	X

^ Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Installed on indoor coil

² Condensing units and heat pumps with reciprocating or rotary compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

[illegible]